



This certificate is not valid if the serial number has been defaced or altered

29871895

EICR18.2c

ELECTRICAL INSTALLATION CONDITION REPORT

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART 1 : DETAILS OF THE CONTRACTOR, CLIENT AND INSTALLATION

DETAILS OF THE CONTRACTOR	(*Where applicable)	DETAILS OF THE CLIENT	DETAILS OF THE INSTALLATION
Registration No: 609526000	Branch No*: 000	Contractor Reference Number (CRN): N/A	Occupier: N/A
Trading Title: Andrew D'auria Solutions Limited T/A AD Gas		Name: Pobl	UPRN: N/A
Address: 197 Neath Road, Landore, Swansea, West Glamorgan		Address: POBL House, Phoenix Way, Swansea Enterprise park, Swansea	Address: Block Caswell, Swansea University, Singleton Park, Swansea
Postcode: SA1 2JT	Tel No: 01792701074	Postcode: SA7 9EX	Tel No: N/A

PART 2 : PURPOSE OF THE REPORT

Purpose for which this report is required:
To determine if the installation is safe for continued use.

Date(s) when inspection and testing was carried out: 17/06/2024 - 28/06/2024

Records available (651): ()

Previous inspection report available (651): ()

Previous report date: (N/A)

PART 3 : SUMMARY OF THE CONDITION OF THE INSTALLATION

General condition of the installation (in terms of electrical safety): Metallic main Consumer Unit supplying x6 3 phase metallic Consumer Units. Main Earthing Conductor is 35mm. Water Bond is in 25mm at the MET/Water stop tap. Gas Bond is in 25mm at MET. Installation is safe for continued use.

Description of premises Dwelling: (N/A) Commercial: () Industrial: (N/A) Other (include brief description): N/A

Estimated age of electrical installation: (17) years Evidence of additions or alterations: (if Yes, estimated age N/A years) Overall assessment of the installation for continued use: **Satisfactory/Unsatisfactory**** (delete as appropriate)

**An unsatisfactory assessment indicates that dangerous (Code C1) and/or potentially dangerous (Code C2) conditions have been identified (listed in PART 5 of this report) and it is recommended that these are acted upon as a matter of urgency.

PART 4 : DECLARATION

INSPECTION AND TESTING

I/We, being the person responsible for the inspection and testing of the electrical installation (as indicated by my/our signature below), particulars of which are described in PART 6, having exercised reasonable skill and care when carrying out the inspection and testing, hereby declare that the information in this report, including the observations (PART 5) and the attached Schedules, provides an accurate assessment of the condition of the electrical installation taking into account the stated extent and limitations in PART 6 of this report.

Name (capitals) on behalf of the contractor identified in PART 1: GRAYSON RICHARDS Signature: Date: 28/06/2024

I/We further RECOMMEND, subject to the necessary remedial action being taken, that the installation is inspected and tested by: 28/06/2029 (date)

Give reason for recommendation: As Per advice given in Guidance Note 3. No adverse findings during the inspection.

The proposed date for the next inspection should take into consideration any legislative or licensing requirements and the frequency and quality of maintenance that the installation can reasonably be expected to receive during its intended life. The period should be agreed between relevant parties.

REVIEWED BY THE REGISTERED QUALIFIED SUPERVISOR FOR THE CONTRACTOR

Name (capitals) on behalf of the contractor identified in PART 1: JORDAN STEEL Signature: Date: 01/07/2024

Original (to the person ordering the work)

ELECTRICAL INSTALLATION CONDITION REPORT

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART 5 : OBSERVATIONS

One of the following Codes, as appropriate, has been allocated to each of the observations made below to indicate to the person(s) responsible for the electrical installation the degree of urgency for remedial action:	Code C1 Danger Present Risk of injury. Immediate remedial action required	Code C2 Potentially Dangerous Urgent remedial action required	Code C3 Improvement Recommended	Code FI Further Investigation Required
---	---	---	---	--

Referring to the **Schedule of Items Inspected** (see PART 9), the attached **Schedule of Circuit Details and Test Results** (see PART 11A & 11B), and subject to any **agreed limitations** listed in PART 6 –

No remedial action is required (), OR The following observations are made:

Item No	Observation(s)	Code	Location Reference
(1)	(6.7 Max Zs values of circuits 6L2 + 6L3 exceed the 80% values stated in BS7671 but do not exceed the 100% values with 30mA RCD protection.	(C3)	(DB1)
(2)	(6.8 Ring Mains wired in 4mm/1.5mm. CPC-CPC readings do not exceed 2.67 times higher than the Live-Live readings.	(C3)	(DB1)
(3)	(6.13 No Rcd protection for cables in walls. 1L1,2L3,3L1,3,L2,4L3,5L3,10L1,10L2,10L3	(C3)	(DB1)
(4)	(..... No SPD in Consumer Unit	(C3)	(DB1)
(5)	(..... All spotlights in lobby area's not working. Disconnected, terminated into junction box and left in situ at time of testing.	(✓)	(Lift lobby areas)
(6)	(..... Faulty neon indicator on cooker switch. Switch replaced at time of testing.	(✓)	(Caswell 2K2)
(7)	(..... Faulty Pir motion sensor in corridor near kitchen 5K2. Rectified at time of testing	(✓)	(Corridor 5th floor)
(8)	(..... Faulty 600x600 ceiling tile light in corridor, replaced at time of testing.	(✓)	(Floor 3)
(9)	(..... IP4X not met at top of all DB's. This has been rectified at time of testing with fire board and fire sealant.	(✓)	(All Consumer Units)
(10)	(..... 6.13 (522.6.202) no rcd protection for cables buried in walls. 1L1,2L1,3L2,3L3,4L1,10L2,10L3	(C3)	(DB 2)
(11)	(..... 6.13 (522.6.202) no rcd protection for cables buried in walls.1L2,2L2,3L1,3L3,4L2,10L1,10L3	(C3)	(DB3)
(12)	(..... 6.13 (522.6.202) no rcd protection for cables buried in walls. 1L3,2L3,4L3,5L3,10L1,10L2	(C3)	(DB4)
(13)	(..... 6.13 (522.6.202) no rcd protection for cables buried in walls.	(C3)	(DB5)
(14)	(..... 6.13 (522.6.202) no rcd protection for cables buried in walls. 1L2,2L2,3L1,3L3,4L2,10L1,10L3	(C3)	(DB6)
(15)	(..... Replace faulty fan boost switch.	(✓)	(Floor 3)
(16)	(..... 6.8 Ring Mains wired in 4mm/1.5mm. CPC-CPC readings do not exceed 2.67 times higher than the Live-Live readings.	(C3)	(DB2)
(17)	(..... 6.8 Ring Mains wired in 4mm/1.5mm. CPC-CPC readings do not exceed 2.67 times higher than the Live-Live readings.	(C3)	(DB3)
(18)	(..... 6.8 Ring Mains wired in 4mm/1.5mm. CPC-CPC readings do not exceed 2.67 times higher than the Live-Live readings.	(C3)	(DB4)
(19)	(..... 6.8 Ring Mains wired in 4mm/1.5mm. CPC-CPC readings do not exceed 2.67 times higher than the Live-Live readings.	(C3)	(DB5)
(20)	(..... 6.8 Ring Mains wired in 4mm/1.5mm. CPC-CPC readings do not exceed 2.67 times higher than the Live-Live readings.	(C3)	(DB6)

Immediate remedial action required for items: (N/A)	Improvement recommended for items: (1,2,3,4,10,11,12,13,14,16,17,18,19,20)
Urgent remedial action required for items: (N/A)	Further investigation required for items: (N/A)
Additional pages? (Yes) State page numbers: (51)	

Original (to the person ordering the work)

ELECTRICAL INSTALLATION CONDITION REPORT

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART 6 : DETAILS AND LIMITATIONS OF THE INSPECTION AND TESTING

The inspection and testing has been carried out in accordance with BS 7671: 2018, as amended to 2022 (date). Cables concealed within trunking and conduits, or cables and conduits concealed under floors, in inaccessible roof spaces and generally within the fabric of the building or underground, have not been visually inspected unless specifically agreed between the Client and the Inspector prior to inspection.

Details of the electrical installation covered by this report: **All fixed wiring from associated distribution boards within building.**

Agreed limitations including the reasons, if any, on the inspection and testing (653.2): **Insulation Resistance tested between LN-E of each circuit. No testing of heating control circuits. Visual inspection of the Suppliers equipment only. No disturbance to fabric of the Building.**

Extent of sampling: **20% of accessories. Inspection and test of Consumer Unit. Main protective bonding conductors and final circuits.**

Operational limitations including the reasons: **No testing of lift supply. No access to main incoming at Union House.**

Agreed with (print name): **CLIENT**

PART 7 : SUPPLY CHARACTERISTICS AND EARTHING ARRANGEMENTS

System type and earthing arrangements			Number and type of live conductors			Nature of supply parameters		
TN-C: (N/A)	TN-S: (N/A)	TN-C-S: (N/A)	AC 1-phase, 2-wire: (N/A)	2-phase, 3-wire: (N/A)	Nominal voltage between lines, $U^{[1]}$: (400) V	Nominal line voltage to Earth, $U_o^{[1]}$: (230) V	Nominal frequency, $f^{[1]}$: (50) Hz	Prospective fault current, $I_{pf}^{[2]*}$: (6.57) kA
TT: (N/A)	IT: (N/A)		3-phase, 3-wire: (N/A)	3-phase, 4-wire: (✓)				
Supply protective device			DC 2-wire: (N/A)	3-wire: (N/A)	Other: (N/A)	Confirmation of supply polarity: (✓)		
BS EN: (LIM)	Type: (N/A)	Rated current: (LIM) A	Other sources of supply (Schedule of Test Results)			Page No: (N/A)		
						External earth fault loop impedance, $Z_e^{[2]*}$: (0.07) Ω		

PART 8 : PARTICULARS OF INSTALLATION REFERRED TO IN THIS REPORT

Means of Earthing	Main protective conductors	Main protective bonding connections	Main switch / Switch-fuse / Circuit-breaker / RCD
Maximum demand (load): (N/A) kVA/✗ (delete as appropriate)	Earthing conductor: (material Copper)	Water installation pipes: (✓)	Location: (MDB Ground floor electrical room)
Distributor's facility: (✓)	csa (35) mm ² Connection/continuity verified: (✓)	Gas installation pipes: (✓)	BS EN: (60947-3) Type: (3) Rating / setting of device: (N/A) A
Installation earth electrode(s): (N/A)	Main protective bonding conductors: (material Copper)	Structural steel: (N/A)	No. of poles: (3) Current rating: (125) A Voltage rating: (400) V
Earth electrode type - rod(s), tape, etc: (None)	csa (25) mm ² Connection/continuity verified: (✓)	Oil installation pipes: (N/A)	Where an RCD is used as the main switch
Location: (N/A)		Lightning protection: (✓)	RCD rated residual operating current, $I_{\Delta n}$: (N/A) mA RCD Type: (N/A)
Electrode resistance to Earth: (N/A) Ω		Other (state): (N/A)	Rated time delay: (N/A) ms Measured operating time: (N/A) ms
		(N/A)	

*Where the installation is supplied by more than one source, the higher or highest values of prospective fault current, I_{pf} , and external earth fault loop impedance, Z_e , must be recorded.

All fields must be completed. Enter either, as appropriate: '✓' if Acceptable condition; 'N/A' if Not applicable; 'LIM' if a Limitation exists, or Code appropriately: CODE 'C1', 'C2', 'C3' or 'FI' (codes to be recorded in PART 5, with additional comments (where appropriate) on attached numbered sheets)

Original (to the person ordering the work)

ELECTRICAL INSTALLATION CONDITION REPORT

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART 9 : SCHEDULE OF ITEMS INSPECTED (enter ✓, N/A or Classification Code C1, C2, C3 or FI, as applicable)

1.0 Intake equipment (visual inspection only) <i>An outcome against an item in section 1.1, other than access to live parts, should not be used to determine the overall assessment of the installation. Where inadequacies are identified, a cross should be put against the appropriate item and a comment made in Part 5 of this report.</i>		<ul style="list-style-type: none"> ▪ Accessibility of all protective bonding connections (543.3.2) (.....✓) ▪ Provision of earthing / bonding labels at all appropriate locations (514.13.1) (.....✓) 	4.16 Confirmation that integral test button / switch, where present, causes AFDD to trip when operated (643.10) (N/A.....)
1.1 Distributor / supplier intake equipment	(N/A.....)	3.2 FELV - requirements satisfied (411.7) (N/A.....)	4.17 Presence of diagrams, charts or schedules at or near equipment, where required (514.9.1) (.....✓)
<ul style="list-style-type: none"> ▪ Service cable (N/A.....) ▪ Service head (N/A.....) ▪ Earthing arrangement (N/A.....) ▪ Meter tails (N/A.....) ▪ Metering equipment (N/A.....) ▪ Isolator, where present (N/A.....) 	(N/A.....)	3.3 Other methods of protection <i>Where any of the methods listed below are employed, details should be provided on separate sheets</i>	4.18 Presence of alternative supply warning notice at or near equipment, where required (514.15) (N/A.....)
<i>Where inadequacies in the intake equipment are encountered, which may result in a dangerous or potentially dangerous situation, the person ordering the work and / or dutyholder must be informed. It is strongly recommended that the person ordering the work informs the appropriate authority.</i>	(N/A.....)	<ul style="list-style-type: none"> ▪ Non-conducting location (418.1) (N/A.....) ▪ Earth-free local equipotential bonding (418.2) (N/A.....) ▪ Electrical separation (413; 418.3) (.....✓) ▪ Double insulation (412) (.....✓) ▪ Reinforced insulation (412) (N/A.....) ▪ Provisions where automatic disconnection of supply is not feasible (419) (N/A.....) 	4.19 Presence of next inspection recommendation label, where required (514.12.1) (.....✓)
1.2 Consumer's isolator, where present (N/A.....)	(N/A.....)	4.0 Distribution equipment, including consumer units and distribution boards	4.20 Presence of other required labelling (please specify) (514) (.....✓)
1.3 Consumer's meter tails (.....✓)	(.....✓)	4.1 Adequacy of working space / accessibility to equipment (132.12; 513.1) (.....✓)	4.21 Compatibility of protective devices, bases and other components; correct type and rating (no signs of unacceptable thermal damage, arcing or overheating) (432; 433; 434) (.....✓)
2.0 Presence of adequate arrangements for parallel or switched alternative sources	(N/A.....)	4.2 Security of fixing (134.1.1) (.....✓)	4.22 Single-pole switching or protective devices in line conductors only (132.14.1; 530.3.3) (.....✓)
2.1 Adequate arrangements where a generating set operates as a switched alternative to the public supply (551.6) (N/A.....)	(N/A.....)	4.3 Condition of insulation of live parts (416.1) (.....✓)	4.23 Protection against mechanical damage where cables enter equipment (522.8.1; 522.8.5; 522.8.11) (.....✓)
2.2 Adequate arrangements where a generating set operates in parallel with the public supply (551.7) (N/A.....)	(N/A.....)	4.4 Adequacy security of barriers or enclosures (416.2.3) (.....✓)	4.24 Protection against electromagnetic effects where cables enter ferromagnetic enclosures (521.5.1) (.....✓)
3.0 Methods of protection	(N/A.....)	4.5 Condition of enclosure(s) in terms of IP rating, etc. (416.2) (.....✓)	4.25 Confirmation that ALL conductor connections, including connections to busbars, are correctly located in terminals and are tight and secure (526.1) (.....✓)
3.1 Automatic disconnection of supply (ADS)	(.....✓)	4.6 Condition of enclosure(s) in terms of fire rating, etc. (421.1.201; 421.1.6; 526.5) (.....✓)	5.0 Distribution circuits
<ul style="list-style-type: none"> ▪ Main earthing / bonding arrangement (411.3; Chap. 54) (.....✓) ▪ Presence of distributor's earthing arrangement (542.1.2.1; 542.1.2.2), or presence of installation earth electrode arrangement (542.1.2.3) (N/A.....) ▪ Adequacy of earthing conductor size (542.3; 543.1.1) (.....✓) ▪ Adequacy of earthing conductor connections (542.3.2) (.....✓) ▪ Accessibility of earthing conductor connections (543.3.2) (.....✓) ▪ Adequacy of main protective bonding conductor sizes (544.1.1) (.....✓) ▪ Adequacy and location of main protective bonding conductor connections (544.1.2) (.....✓) 	(.....✓)	4.7 Enclosure not damaged / deteriorated so as to impair safety (651.2) (.....✓)	5.1 Identification of conductors (514.3) (.....✓)
		4.8 Presence and effectiveness of obstacles (417.2) (N/A.....)	5.2 Cables correctly supported throughout their run (521.10.202; 522.8.5) (.....✓)
		4.9 Presence of main switch(es), linked where required (462.1; 462.1.201; 462.2) (.....✓)	5.3 Condition of insulation of live parts (416.1) (.....✓)
		4.10 Operation of main switch(es) (functional check) (643.10) (.....✓)	5.4 Non-sheathed cables protected by enclosure in conduit, ducting or trunking (521.10.1) (N/A.....)
		4.11 Manual operation of circuit-breakers, RCDs and AFDDs to prove functionality (643.10) (.....✓)	5.5 Suitability of containment systems for continued use (including flexible conduit) (522) (.....✓)
		4.12 Confirmation that integral test button / switch causes RCD(s) to trip when operated (functional check) (643.10) (.....✓)	5.6 Cables correctly terminated in enclosures (526) (.....✓)
		4.13 RCD(s) provided for fault protection - includes RCBOs (411.4.204; 411.4.5; 411.5.2; 531.2) (N/A.....)	5.7 Examination of cables for signs of unacceptable thermal or mechanical damage / deterioration (421.1; 522.6) (.....✓)
		4.14 RCD(s) provided for additional protection / requirements, where required - includes RCBOs (411.3.3; 415.1) (.....✓)	5.8 Adequacy of cables for current-carrying capacity with regard for the type and nature of installation (523) (.....✓)
		4.15 Presence of RCD six-monthly test notice, where required (514.12.2) (.....✓)	

Original (to the person ordering the work)

ELECTRICAL INSTALLATION CONDITION REPORT

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART 9 : SCHEDULE OF ITEMS INSPECTED (enter ✓, N/A or Classification Code C1, C2, C3 or FI, as applicable)

5.9	Adequacy of protective devices; type and rated current for fault protection (411.3)	(.....) ✓	6.2	Cables correctly supported throughout their run (521.10.202; 522.8.5)	(.....) LIM	<ul style="list-style-type: none"> *For cables concealed in walls / partitions containing metal parts regardless of depth (522.6.203) *For final circuits supplying luminaires within domestic (household) premises (411.3.4) 	(.....) N/A	
5.10	Presence and adequacy of circuit protective conductors (411.3.1.1; 543.1)	(.....) ✓	6.3	Condition of insulation of live parts (416.1)	(.....) ✓		(.....) N/A	
5.11	Coordination between conductors and overload protective devices (433.1; 533.2.1)	(.....) ✓	6.4	Non-sheathed cables protected by enclosure in conduit, ducting or trunking (521.10.1)	(.....) N/A	<p>*Older installations designed prior to BS 7671: 2018 may not have required RCDs for additional protection.</p>	(.....) N/A	
5.12	Cable installation methods / practices with regard to the type and nature of installation and external influences (522)	(.....) ✓	6.5	Suitability of containment systems for continued use (including flexible conduit) (522)	(.....) ✓		6.14	Provision of fire barriers, sealing arrangements and protection against thermal effects (527)
5.13	Where exposed to direct sunlight, cable of a suitable type (522.11.1)	(.....) N/A	6.6	Adequacy of cables for current-carrying capacity with regard to the type and nature of installation (523)	(.....) ✓	6.15	Band II cables segregated / separated from Band I cables (528.1)	(.....) LIM
5.14	Cables concealed under floors, above ceilings, in walls / partitions, adequately protected against damage (522.6.201; 522.6.202; 522.6.203; 522.6.204) –	(.....) LIM	6.7	Adequacy of protective devices; type and rated current for fault protection (411.3)	(.....) C3	6.16	Cables segregated / separated from non-electrical services (528.3)	(.....) LIM
<ul style="list-style-type: none"> Installed in prescribed zones (see Section D. <i>Extent and limitations</i>) (522.6.202) Incorporating earthed armour or sheath, or run within earthed wiring system, or otherwise protected against mechanical damage by nails, screws and the like (see Section D) (522.6.201; 522.6.204) 	6.8		Presence and adequacy of circuit protective conductors (411.3.1.1; 543.1)	(.....) C3	6.17	Termination of cables at enclosures - identify / record numbers and locations of items inspected (526) –	(.....) ✓	
5.15	Provision of fire barriers, sealing arrangements and protection against thermal effects (527)	(.....) ✓	6.9	Co-ordination between conductors and overload protective devices (433.1; 533.2.1)	(.....) ✓	<ul style="list-style-type: none"> Connection under no undue strain (526.6) No basic insulation of a conductor visible outside enclosure (526.8) Connections of live conductors adequately enclosed (526.5) Adequately connected at point of entry to enclosure (glands, bushes, etc.) (522.8.5) 		(.....) ✓
5.16	Band II cables segregated / separated from Band I cables (528.1)	(.....) LIM	6.10	Wiring system(s) appropriate for the type and nature of the installation and external influences (522)	(.....) ✓	6.18	Condition of accessories including socket-outlets, switches and joint boxes (651.2)	(.....) ✓
5.17	Cables segregated / separated from non-electrical services (528.3)	(.....) LIM	6.11	Where exposed to direct sunlight, cable of a suitable type (522.11.1)	(.....) ✓	6.19	Suitability of accessories for external influences (512.2)	(.....) ✓
5.18	Condition of circuit accessories (651.2)	(.....) ✓	6.12	Cables concealed under floors, above ceilings, in walls / partitions, adequately protected against damage (522.6.201; 522.6.202; 522.6.203; 522.6.204) –	(.....) LIM	6.20	Single-pole switching or protective devices in line conductors only (132.14.1; 530.3.3)	(.....) ✓
5.19	Suitability of circuit accessories for external influences (512.2)	(.....) ✓	<ul style="list-style-type: none"> Installed in prescribed zones (see Section D. <i>Extent and limitations</i>) (522.6.202) Incorporating earthed armour or sheath, or run within earthed wiring system, or otherwise protected against mechanical damage by nails, screws and the like (see Section D) (522.6.201; 522.6.204) 	(.....) N/A		<p>7.0 Isolation and switching</p>		
5.20	Single-pole switching or protective devices in line conductors only (132.14.1; 530.3.3)	(.....) ✓	6.13	Provision of additional protection by RCD having rated residual operating current not exceeding 30 mA –	(.....) ✓	7.1	Isolators –	(.....) ✓
5.21	Adequacy of connections, including cpcs, within accessories and to fixed and stationary equipment - identify / record numbers and locations of items inspected (526)	(.....) ✓	<ul style="list-style-type: none"> *For all socket-outlets of rating 32 A or less (411.3.3) 	(.....) ✓	<ul style="list-style-type: none"> Presence and condition of appropriate devices (462; 537.2) Acceptable location - state if local or remote from equipment in question (462; 537.2.7) Capable of being secured in the OFF position (462.3) Correct operation verified (643.10) Clearly identified by position and / or durable marking (537.2.7) 	(.....) ✓		
5.22	Presence, operation and correct location of appropriate devices for isolation and switching (Chap. 46; 537)	(.....) ✓	<p><i>Additional protection by RCD may not have been provided as a noted exception in certain non-domestic installations covered by indent (ii) of Regulation 411.3.3.</i></p>	(.....) C3	<ul style="list-style-type: none"> *For the supply of mobile equipment not exceeding 32 A rating for use outdoors (411.3.3) *For cables concealed in walls at a depth of less than 50 mm (522.6.202) 	(.....) ✓	(.....) N/A	
5.23	General condition of wiring system (651.2)	(.....) ✓				<ul style="list-style-type: none"> Warning label posted in situations where live parts cannot be isolated by the operation of a single device (514.11.1; 5371.2) 	(.....) ✓	
5.24	Temperature rating of cable insulation (522.1.1; Table 52.1)	(.....) ✓						
6.0 Final circuits								
6.1	Identification of conductors (514.3)	(.....) ✓						

Original (to the person ordering the work)

ELECTRICAL INSTALLATION CONDITION REPORT


Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART 9 : SCHEDULE OF ITEMS INSPECTED (enter ✓, N/A or Classification Code C1, C2, C3 or FI, as applicable)

7.2	Switching off for mechanical maintenance –		8.5	Security of fixing (134.1.1)	(.....✓.....)	▪ Low voltage (e.g. 230 volt) socket-outlets sited at least 2.5 m from zone 1 (701.512.3)	(.....N/A.....)
	▪ Presence and condition of appropriate devices (464.1; 5373.2)	(.....✓.....)	8.6	Cable entry holes in ceiling above luminaires, sized or sealed so as to restrict the spread of fire: list number and location of luminaires inspected (separate page) (527.2)	(.....✓.....)	▪ Suitability of equipment for external influences for installed location in terms of IP rating (701.512.2)	(.....✓.....)
	▪ Capable of being secured in the OFF position where not under continuous supervision (464.2)	(.....✓.....)	8.7	Recessed luminaires (downlighters) –		▪ Suitability of accessories and controlgear etc. for a particular zone (701.512.3)	(.....✓.....)
	▪ Correct operation verified (643.10)	(.....✓.....)		▪ Correct type of lamps fitted (559.3.1)	(.....N/A.....)	▪ Suitability of current-using equipment for particular position within the location (701.55)	(.....✓.....)
	▪ Clearly identified by position and / or durable marking (5373.2.4)	(.....✓.....)		▪ Installed to minimise build-up of heat by use of “fire rated” fittings, insulation displacement box or similar (421.1.2)	(.....N/A.....)	9.2	Other special installations or locations –
7.3	Emergency switching off –			▪ No signs of overheating to surrounding building fabric (559.4.1)	(.....N/A.....)		N/A
	▪ Presence and condition of appropriate devices (465; 5373.3; 5374)	(.....N/A.....)		▪ No signs of overheating to conductors / terminations (526.1)	(.....N/A.....)		(.....N/A.....)
	▪ Readily accessible for operation where danger might occur (5373.3.6)	(.....N/A.....)					(.....)
	▪ Correct operation verified (643.10)	(.....N/A.....)					(.....)
	▪ Clearly identified by position and / or durable marking (5373.3.5; 5373.3.6; 5374.3; 5374.4)	(.....N/A.....)					(.....)
7.4	Functional switching –		9.0	Special locations and installations			(.....)
	▪ Presence and condition of appropriate devices (5373.1.1; 5373.1.2)	(.....✓.....)		Where special installations or locations relating to a particular Section of Part 7, an additional Inspection Schedule(s) should be provided on separate pages.			(.....)
	▪ Correct operation verified (643.10)	(.....✓.....)	9.1	Location(s) containing a bath or shower –			(.....)
				▪ Additional protection by RCD having rated residual operating current not exceeding 30 mA for all low voltage (LV) circuits serving the location or passing through zones 1 and / or 2 of the location (701.411.3.3)	(.....✓.....)	10.0	Prosumer’s low voltage installation
				▪ Where used as a protective measure, requirements for SELV or PELV met (701.414.4.5)	(.....N/A.....)		(.....N/A.....)
8.0	Current-using equipment (permanently connected)			▪ Shaver supply units complying with BS EN 61558-2-5 formerly BS 3535 (701.512.3)	(.....✓.....)		Where elements of a prosuming installation falling within the scope of Chapter 82 are covered by the report, additional schedules detailing the associated inspection and testing should be provided on separate pages.
8.1	Condition of equipment in terms of IP rating, etc. (416.2; 422.3; 422.4; 522.4)	(.....✓.....)		▪ Presence of supplementary bonding conductors, unless not required by BS 7671: 2018 (701.415.2)	(.....N/A.....)		
8.2	Equipment does not constitute a fire hazard (421)	(.....✓.....)					
8.3	Enclosure not damaged / deteriorated so as to impair safety (134.1.1; 416.2)	(.....✓.....)					
8.4	Suitability for the environment and external influences (512.2)	(.....✓.....)					

PART 10 : SCHEDULES AND ADDITIONAL PAGES (the pages identified are an essential part of this report (see Regulation 653.2))

Schedule of Inspections	Schedule of Circuit Details and Test Results for the installation	Additional pages, including data sheets for additional sources	Special installations or locations (indicated in item 9.2 above)	Schedules relating to Prosumer’s installations (indicated in item 10 above)	Continuation sheets
Page No(s): (.....4, 5 & 6.....)	Page No(s): (.....7 & 8.....)	Page No(s): (.....52.....)	Page No(s): (.....49.....)	Page No(s): (.....50.....)	Page No(s): (.....53-97.....)

Schedule of Items Inspected by
 Name (capitals): GRAYSON RICHARDS
 Signature:  Date: 28/06/2024

Original (to the person ordering the work)

ELECTRICAL INSTALLATION CONDITION REPORT

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART 11A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part 11B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART 11B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
	Main Switch	N/A	N/A	N/A	N/A	N/A	N/A	60947-3	3	125	N/A	N/A	N/A	N/A	N/A	N/A
1L1	DB1 Ground Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
1L2	DB1 Ground Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
1L3	DB1 Ground Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
2L1	DB2 1st Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
2L2	DB2 1st Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
2L3	DB2 1st Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
3L1	DB3 2nd Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
3L2	DB3 2nd Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
3L3	DB3 2nd Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
4L1	DB4 3rd Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
4L2	DB4 3rd Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
4L3	DB4 3rd Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
5L1	DB5 4th Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
5L2	DB5 4th Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
5L3	DB5 4th Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
6L1	DB6 5th Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A
6L2	DB6 5th Floor	F	E	1	16	16	5	60947-2	MCCB	80	16	N/A	N/A	N/A	N/A	N/A

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: <small>MDB Caswell, 12way TP+N, Main LV Switch Board</small></p> <p>Location of DB: <small>Caswell building - Ground Floor Switchroom</small></p> <p>Z_{db}: 0.07 (Ω) I_{pf} at DB: 6.57 (kA)</p> <p>Confirmation of supply polarity: (<input checked="" type="checkbox"/>) Phase sequence confirmed†: (<input checked="" type="checkbox"/>)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (<input checked="" type="checkbox"/>)</p> <p>Status indicator checked (where functionality indicator is present): (<input checked="" type="checkbox"/>)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART 11B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: N/A</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (N/A) Type: (N/A) Nominal voltage: (N/A) V Rating: (N/A) A No. of phases: (N/A)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
---	---	--

ELECTRICAL INSTALLATION CONDITION REPORT

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART 11B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part 11A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)	
	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
1L1	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.12	N/A	N/A	N/A	N/A
1L2	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.13	N/A	N/A	N/A	N/A
1L3	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.12	N/A	N/A	N/A	N/A
2L1	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.12	N/A	N/A	N/A	N/A
2L2	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.10	N/A	N/A	N/A	N/A
2L3	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.09	N/A	N/A	N/A	N/A
3L1	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.11	N/A	N/A	N/A	N/A
3L2	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.11	N/A	N/A	N/A	N/A
3L3	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.11	N/A	N/A	N/A	N/A
4L1	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.12	N/A	N/A	N/A	N/A
4L2	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.12	N/A	N/A	N/A	N/A
4L3	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.12	N/A	N/A	N/A	N/A
5L1	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.15	N/A	N/A	N/A	N/A
5L2	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.14	N/A	N/A	N/A	N/A
5L3	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.18	N/A	N/A	N/A	N/A
6L1	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.15	N/A	N/A	N/A	N/A
6L2	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.15	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps,neons,Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *G. Richards* Date: 17/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	---	--	--	---	---	--------------------------------	--------------------------------	------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
					6L3	DB6 5th Floor		F	E	1	16	16	5	60947-2	MCCB	80
7L1	Mechanical Control Panel Plantroom	F	E	1	16	16	5	60947-2	MCCB	63	16	N/A	N/A	N/A	N/A	N/A
7L2	Mechanical Control Panel Plantroom	F	E	1	16	16	5	60947-2	MCCB	63	16	N/A	N/A	N/A	N/A	N/A
7L3	Mechanical Control Panel Plantroom	F	E	1	16	16	5	60947-2	MCCB	63	16	N/A	N/A	N/A	N/A	N/A
8L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	60947-2	MCCB	63	16	N/A	N/A	N/A	N/A	N/A
8L3	Fire alarm panel	A	C	1	2.5	2.5	0.4	60947-2	MCCB	16	16	N/A	N/A	N/A	N/A	N/A
9L1	Lift Supply	F	E	1	16	16	5	60947-2	MCCB	63	16	N/A	N/A	N/A	N/A	N/A
9L2	Lift Supply	F	E	1	16	16	5	60947-2	MCCB	63	16	N/A	N/A	N/A	N/A	N/A
9L3	Lift Supply	F	E	1	16	16	5	60947-2	MCCB	63	16	N/A	N/A	N/A	N/A	N/A
10L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

DISTRIBUTION BOARD (DB) DETAILS (complete in every case)

MDB Caswell, 12way TP+N.
 DB designation: Main LV Switch Board
 Caswell building - Ground
 Location of DB: Floor, Switchroom

Z_{db}: 0.07 (Ω) I_{pf} at DB: 6.57 (kA)

Confirmation of supply polarity: (✓) Phase sequence confirmed†: (✓)

SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)

Status indicator checked (where functionality indicator is present): (N/A)

**SPD Type.
 Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.
 Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).
 Note that not all SPDs have visible functionality indication.

TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION

Supply to DB is from: N/A

Overcurrent protective device for the distribution circuit
 BS (EN): (N/A) Type: (N/A) Nominal voltage: (N/A) V Rating: (N/A) A No. of phases: (N/A)

Associated RCD (if any)
 BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**		Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button		
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)		
6L3	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.14	N/A	N/A	N/A	N/A	
7L1	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.18	N/A	N/A	N/A	N/A	
7L2	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.16	N/A	N/A	N/A	N/A	
7L3	N/A	N/A	N/A	N/A	N/A	LIM	>999	500	✓	0.16	N/A	N/A	N/A	N/A	
8L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A	
8L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
8L3	N/A	N/A	N/A	0.21	N/A	LIM	821	500	✓	0.28	N/A	N/A	N/A	N/A	
9L1	N/A	N/A	N/A	LIM	N/A	LIM	LIM	N/A	LIM	LIM	N/A	N/A	N/A	N/A	
9L2	N/A	N/A	N/A	LIM	N/A	LIM	LIM	N/A	LIM	LIM	N/A	N/A	N/A	N/A	
9L3	N/A	N/A	N/A	LIM	N/A	LIM	LIM	N/A	LIM	LIM	N/A	N/A	N/A	N/A	
10L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
10L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
10L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
12L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
12L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, neons, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 17/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)

Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A
-------------------------------------	--------------------	-------------------------------	------------------------------------	------------------------------------	-------------

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	---	--	--	---	---	--------------------------------	--------------------------------	------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live	cpc		BS (EN)	Type	Rating	Short-circuit capacity	Maximum permitted Zs*	BS (EN)	Type	Rating	Operating current, I _{Δn}	
					(mm ²)	(mm ²)											(A)
12L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: MDB Caswell, 12way TP+N. Main LV Switch Board</p> <p>Location of DB: Caswell building - Ground Floor, Switchroom</p> <p>Z_{db}: 0.07 (Ω) I_{pf} at DB: 6.57 (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (✓)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (N/A)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: N/A</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (N/A) Type: (N/A) Nominal voltage: (N/A) V Rating: (N/A) A No. of phases: (N/A)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
--	---	--



This certificate is not valid if the serial number has been defaced or altered

29871895

ISN18.2c

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

Original (to the person ordering the work)

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live (MΩ)	Live / Earth (MΩ)	Test voltage DC (V)			Operating time* (ms)	Test button (✓)	AFDD test button (✓)	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂									
12L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps,neons,Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *Grayson Richards* Date: 17/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)

Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A
-------------------------------------	--------------------	-------------------------------	------------------------------------	------------------------------------	-------------

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
	Main Switch	N/A	N/A	N/A	N/A	N/A	N/A	60947-3	3	125	N/A	N/A	N/A	N/A	N/A	N/A
1L1	Bedroom Lighting rooms 1-4	A	E	25	1.5	1	0.4	61009	B	10	10	3.5	61009	A	10	30
1L2	Bedroom Lighting rooms 9-12	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30
1L3	Corridor lighting	A	E	12	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
2L1	Bedroom Lighting rooms 5-8	A	E	24	1.5	1	0.4	61009	B	10	10	3.5	61009	A	10	30
2L2	Bedroom Lighting rooms 13-16	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30
2L3	Corridor lighting K2	A	E	11	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
3L1	Kitchen K1 + Switchroom Lighting	A	C	5	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
3L2	Kitchen Lighting K2	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
3L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L3	Lobby + External Canopy Lighting	A	E	13	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
5L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L3	Stairwell Lighting - GF to 3rd Floor	A	E	17	1.5	1	0.4	60898	B	10	10	3.5	N/A	N/A	N/A	N/A
6L1	Bedroom Ring Main rooms 9-12	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
6L2	Bedroom Ring Main rooms 5-8	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30

DISTRIBUTION BOARD (DB) DETAILS (complete in every case)

DB designation: DB1 Caswell-Ground Floor.
Lighting and Small Power
 Caswell building - Ground
 Location of DB: Floor, Switchroom

Z_{db}: 0.13 (Ω) I_{pr} at DB†: 3.58 (kA)

Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)

SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)

Status indicator checked (where functionality indicator is present): (N/A)

**SPD Type.
 Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.
 Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).
 Note that not all SPDs have visible functionality indication.

TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION

Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 1L1

Overcurrent protective device for the distribution circuit
 BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)

Associated RCD (if any)
 BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Zs (Ω)	RCD		AFDD**		Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button		
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)		
	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
1L1	N/A	N/A	N/A	1.65	N/A	LIM	351	500	✓	1.78	28.7	✓	N/A	N/A	
1L2	N/A	N/A	N/A	1.32	N/A	LIM	371	500	✓	1.45	28.8	✓	N/A	N/A	
1L3	N/A	N/A	N/A	0.48	N/A	LIM	823	500	✓	0.61	N/A	N/A	N/A	N/A	
2L1	N/A	N/A	N/A	1.64	N/A	LIM	97.7	500	✓	1.77	28.6	✓	N/A	N/A	
2L2	N/A	N/A	N/A	1.07	N/A	LIM	568	500	✓	1.20	28.8	✓	N/A	N/A	
2L3	N/A	N/A	N/A	0.88	N/A	LIM	735	500	✓	1.01	N/A	N/A	N/A	N/A	
3L1	N/A	N/A	N/A	0.84	N/A	LIM	134	500	✓	0.97	N/A	N/A	N/A	N/A	
3L2	N/A	N/A	N/A	0.52	N/A	LIM	38.5	500	✓	0.65	N/A	N/A	N/A	N/A	
3L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L3	N/A	N/A	N/A	0.67	N/A	LIM	27.7	500	✓	0.80	N/A	N/A	N/A	N/A	
5L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L3	N/A	N/A	N/A	1.11	N/A	LIM	17.5	500	✓	1.24	N/A	N/A	N/A	N/A	
6L1	0.33	0.35	0.86	0.30	N/A	LIM	984	500	✓	0.40	38.6	✓	N/A	N/A	
6L2	0.48	0.45	1.28	0.41	N/A	LIM	817	500	✓	0.55	38.6	✓	N/A	N/A	Zs is greater than 80% and less than 100% of BS7671 values. But protected by an RCD

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 17/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
6L3	General Ring Main - Cor,Srm,Lob,Strs	A	E	8	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L1	Bedroom Ring Main rooms 13-16	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L2	Bedroom Ring Main rooms 1-4	A	E	13	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L3	Lobby Fcu Radial	A	E	1	4	1.5	0.4	60898	C	20	10	0.87	N/A	N/A	N/A	N/A
8L1	Cooker Supply K1	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	32	30
8L2	Cooker Supply K2	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	32	30
8L3	Door Entry,Camera's,Smoke Vents,Refuge	A	E	4	4	1.5	0.4	60898	C	20	10	0.87	N/A	N/A	N/A	N/A
9L1	Kitchen Ring Main K1	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
9L2	Kitchen Ring Main K2	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
9L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L1	Hob Supply K1	A	C	1	4	1.5	0.4	60898	C	25	10	0.70	N/A	N/A	N/A	N/A
10L2	Hob Supply K2	A	C	1	4	1.5	0.4	60898	C	25	10	0.70	N/A	N/A	N/A	N/A
10L3	Wheelchair assist auto doors K1 GF x3	A	E	3	2.5	1.5	0.4	60898	C	16	10	1.10	N/A	N/A	N/A	N/A
11L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: DB1 Caswell-Ground Floor, Lighting and Small Power, Caswell building - Ground</p> <p>Location of DB: Floor, Switchroom</p> <p>Z_{db}: 0.13 (Ω) I_{pf} at DB†: 3.58 (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (N/A)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell, 12way TP+N, Main LV Switch Board - 1L1</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
---	---	--

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Zs (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)	
6L3	0.52	0.52	1.40	0.48	N/A	LIM	8.96	500	✓	0.59	28.8	✓	N/A	Zs is greater than 80% and less than 100% of BS7671 values. But protected by an RCD
7L1	0.41	0.41	1.08	0.35	N/A	LIM	848	500	✓	0.38	38.7	✓	N/A	N/A
7L2	0.48	0.48	1.28	0.44	N/A	LIM	390	500	✓	0.54	38.7	✓	N/A	N/A
7L3	N/A	N/A	N/A	0.28	N/A	LIM	>999	500	✓	0.41	N/A	N/A	N/A	N/A
8L1	N/A	N/A	N/A	0.10	N/A	LIM	>999	500	✓	0.23	18.8	✓	N/A	N/A
8L2	N/A	N/A	N/A	0.29	N/A	LIM	250	500	✓	0.42	28.8	✓	N/A	N/A
8L3	N/A	N/A	N/A	0.16	N/A	LIM	>999	500	✓	0.29	N/A	N/A	N/A	N/A
9L1	0.38	0.39	0.99	0.37	N/A	LIM	147	500	✓	0.50	38.5	✓	N/A	N/A
9L2	0.18	0.18	0.50	0.17	N/A	LIM	105	500	✓	0.31	38.6	✓	N/A	N/A
9L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L1	N/A	N/A	N/A	0.39	N/A	LIM	855	500	✓	0.52	N/A	N/A	N/A	N/A
10L2	N/A	N/A	N/A	0.18	N/A	LIM	>999	500	✓	0.31	N/A	N/A	N/A	N/A
10L3	N/A	N/A	N/A	0.52	N/A	LIM	910	500	✓	0.65	N/A	N/A	N/A	N/A
11L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 17/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)	
																	12L3

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: DB1 Caswell-Ground Floor. Lighting and Small Power.....</p> <p>Location of DB: Caswell building - Ground Floor, Switchroom.....</p> <p>Z_{db}: 0.13 (Ω) I_{pf} at DB†: 3.58 (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (N/A)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 1L1</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
---	---	--

Original (to the person ordering the work)



This certificate is not valid if the serial number has been defaced or altered

29871895

ISN18.2c

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Zs (Ω)	RCD		AFDD**		Comments and additional information, where required	
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button			
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)			
12L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: [Signature] Date: 17/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)

Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A
-------------------------------------	--------------------	-------------------------------	------------------------------------	------------------------------------	-------------

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	---	--	--	---	---	--------------------------------	--------------------------------	------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
						Main Switch		N/A	N/A	N/A	N/A	N/A	N/A	60947-3	3	125
1L1	Corridor lighting K1 + External Ltg	A	E	14	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
1L2	Bedroom Lighting rooms 1-4	A	E	25	1.5	1	0.4	61009	B	10	10	3.5	61009	A	10	30
1L3	Bedroom Lighting rooms 9-12	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30
2L1	Corridor lighting K2	A	E	11	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
2L2	Bedroom Lighting rooms 13-16	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30
2L3	Bedroom Lighting rooms 5-8	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30
3L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
3L2	Kitchen Lighting K1	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
3L3	Kitchen Lighting K2	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
4L1	Lobby Lighting	A	E	10	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
4L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6L1	General Ring Main - Cor,Lob,Strs	A	E	6	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
6L2	Bedroom Ring Main rooms 9-12	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: DB2 Caswell-First Floor.</p> <p>Location of DB: Floor, DB riser.</p> <p>Z_{db}: 0.12 (Ω) I_{pf} at DB†: 3.83 (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (✓)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (✓)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 2L1</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
--	---	--

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**		Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button		
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)		
	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
1L1	N/A	N/A	N/A	1.70	N/A	LIM	>999	500	✓	1.77	N/A	N/A	N/A	N/A	
1L2	N/A	N/A	N/A	0.97	N/A	LIM	>999	500	✓	1.04	28.8	✓	N/A	N/A	
1L3	N/A	N/A	N/A	1.02	N/A	LIM	556	500	✓	1.09	28.8	✓	N/A	N/A	
2L1	N/A	N/A	N/A	1.20	N/A	LIM	>999	500	✓	1.27	N/A	N/A	N/A	N/A	
2L2	N/A	N/A	N/A	1.22	N/A	LIM	>999	500	✓	1.29	28.8	✓	N/A	N/A	
2L3	N/A	N/A	N/A	1.27	N/A	LIM	>999	500	✓	1.34	28.8	✓	N/A	N/A	
3L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
3L2	N/A	N/A	N/A	0.92	N/A	LIM	15.9	500	✓	0.99	N/A	N/A	N/A	N/A	
3L3	N/A	N/A	N/A	0.58	N/A	LIM	15.6	500	✓	0.65	N/A	N/A	N/A	N/A	
4L1	N/A	N/A	N/A	0.79	N/A	LIM	490	500	✓	0.86	N/A	N/A	N/A	N/A	
4L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
6L1	0.47	0.47	1.28	0.43	N/A	LIM	16.7	500	✓	0.47	28.6	✓	N/A	N/A	
6L2	0.34	0.34	0.89	0.31	N/A	LIM	>999	500	✓	0.33	38.7	✓	N/A	N/A	

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 17/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
					6L3	Bedroom Ring Main rooms 5-8		A	E	12	4	1.5	0.4	61009	C	32
7L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
7L2	Bedroom Ring Main rooms 13-16	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L3	Bedroom Ring Main rooms 1-4	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
8L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8L2	Cooker Supply K1	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	32	30
8L3	Cooker Supply K2	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	32	30
9L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
9L2	Kitchen Ring Main K1	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
9L3	Kitchen Ring Main K2	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
10L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L2	Hob Supply K1	A	C	1	6	2.5	0.4	60898	C	32	10	0.54	N/A	N/A	N/A	N/A
10L3	Hob Supply K2	A	C	1	4	1.5	0.4	60898	C	20	10	0.87	N/A	N/A	N/A	N/A
11L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

DISTRIBUTION BOARD (DB) DETAILS (complete in every case)

DB designation: DB2 Caswell-First Floor.
 Location of DB: Floor, DB riser.
 Z_{db}: 0.12 (Ω) I_{pf} at DB†: 3.83 (kA)
 Confirmation of supply polarity: (✓) Phase sequence confirmed†: (✓)
 SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)
 Status indicator checked (where functionality indicator is present): (N/A)

**SPD Type.
 Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.
 Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).
 Note that not all SPDs have visible functionality indication.

TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION

Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 2L1
 Overcurrent protective device for the distribution circuit
 BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)
 Associated RCD (if any)
 BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)	
6L3	0.44	0.44	1.15	0.40	N/A	LIM	2.81	500	✓	0.47	38.7	✓	N/A	N/A
7L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
7L2	0.34	0.34	0.92	0.32	N/A	LIM	743	500	✓	0.36	38.6	✓	N/A	N/A
7L3	0.49	0.49	1.33	0.46	N/A	LIM	372	500	✓	0.50	38.7	✓	N/A	N/A
8L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8L2	N/A	N/A	N/A	0.31	N/A	LIM	888	500	✓	0.38	28.8	✓	N/A	N/A
8L3	N/A	N/A	N/A	0.11	N/A	LIM	147	500	✓	0.18	28.8	✓	N/A	N/A
9L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
9L2	0.30	0.30	0.83	0.28	N/A	LIM	246	500	✓	0.36	29.1	✓	N/A	N/A
9L3	0.18	0.20	0.52	0.18	N/A	LIM	239	500	✓	0.28	28.5	✓	N/A	N/A
10L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L2	N/A	N/A	N/A	0.34	N/A	LIM	791	500	✓	0.41	N/A	N/A	N/A	N/A
10L3	N/A	N/A	N/A	0.18	N/A	LIM	>999	500	✓	0.25	N/A	N/A	N/A	N/A
11L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 17/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

 * RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn})

** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live (mm²)	cpc (mm²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)	
12L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: DB2 Caswell-First Floor. Lighting and Small Power.....</p> <p>Location of DB: Floor DB riser.....</p> <p>Z_{db}: 0.12..... (Ω) I_{pf} at DB†: 3.83..... (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (✓)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (N/A)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 2L1.....</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
---	---	---

Original (to the person ordering the work)



This certificate is not valid if the serial number has been defaced or altered

29871895

ISN18.2c

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)	
12L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature:  Date: 17/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)

Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A
-------------------------------------	--------------------	-------------------------------	------------------------------------	------------------------------------	-------------

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
--------------------------	---	--	--	---	---	--------------------------------	--------------------------------	------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live	cpc		BS (EN)	Type	Rating	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
					(mm ²)	(mm ²)										
	Main Switch	N/A	N/A	N/A	N/A	N/A	N/A	60947-3	3	125	N/A	N/A	N/A	N/A	N/A	N/A
1L1	Bedroom Lighting 9-12	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30
1L2	Corridor lighting K1	A	E	12	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
1L3	Bedroom Lighting 1-4	A	E	25	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30
2L1	Bedroom Lighting 13-16	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30
2L2	Corridor lighting K2	A	E	11	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
2L3	Bedroom Lighting 5-8	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30
3L1	Kitchen Lighting K2	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
3L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
3L3	Kitchen Lighting K1	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
4L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L2	Lobby Lighting	A	E	10	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A
4L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6L1	Bedroom Ring Main 5-8	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
6L2	General Ring Main - Cor,Lob,Strs	A	E	6	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: DB3 Caswell-Second Floor. Lighting and Small Power. Caswell building - Second</p> <p>Location of DB: Floor, DB riser.....</p> <p>Z_{db}: 0.11 (Ω) I_{pf} at DB: 4.24 (kA)</p> <p>Confirmation of supply polarity: (<input checked="" type="checkbox"/>) Phase sequence confirmed†: (<input checked="" type="checkbox"/>)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (<input checked="" type="checkbox"/>)</p> <p>Status indicator checked (where functionality indicator is present): (<input checked="" type="checkbox"/>)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 3L1</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
---	---	--

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)	
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
1L1	N/A	N/A	N/A	1.35	N/A	LIM	728	500	✓	1.42	28.8	✓	N/A	N/A
1L2	N/A	N/A	N/A	1.63	N/A	LIM	>999	500	✓	1.70	N/A	N/A	N/A	N/A
1L3	N/A	N/A	N/A	1.62	N/A	LIM	785	500	✓	1.69	28.7	✓	N/A	N/A
2L1	N/A	N/A	N/A	1.08	N/A	LIM	572	500	✓	1.15	28.8	✓	N/A	N/A
2L2	N/A	N/A	N/A	1.59	N/A	LIM	>999	500	✓	1.65	N/A	N/A	N/A	N/A
2L3	N/A	N/A	N/A	1.21	N/A	LIM	478	500	✓	1.28	28.8	✓	N/A	N/A
3L1	N/A	N/A	N/A	0.60	N/A	LIM	790	500	✓	0.67	N/A	N/A	N/A	N/A
3L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
3L3	N/A	N/A	N/A	0.97	N/A	LIM	710	500	✓	1.04	N/A	N/A	N/A	N/A
4L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L2	N/A	N/A	N/A	0.77	N/A	LIM	>999	500	✓	0.84	N/A	N/A	N/A	N/A
4L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6L1	0.45	0.45	1.22	0.39	N/A	LIM	928	500	✓	0.52	38.6	✓	N/A	N/A
6L2	0.58	0.60	1.50	0.51	N/A	LIM	17.1	500	✓	0.60	28.5	✓	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 20/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live	cpc		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
					(mm ²)	(mm ²)										
6L3	Bedroom Ring Main 9-12	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L1	Bedroom Ring Main 1-4	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
7L3	Bedroom Ring Main 13-16	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
8L1	Cooker Supply K2	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	32	30
8L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8L3	Cooker Supply K1	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	32	30
9L1	Kitchen Ring Main K2	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
9L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
9L3	Kitchen Ring Main K1	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
10L1	Hob Supply K2	A	C	1	4	1.5	0.4	60898	C	20	10	0.87	N/A	N/A	N/A	N/A
10L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L3	Hob Supply K1	A	C	1	4	1.5	0.4	60898	C	20	10	0.87	N/A	N/A	N/A	N/A
11L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: DB3 Caswell-Second Floor. Lighting and Small Power. Caswell building - Second Floor. DB riser.</p> <p>Location of DB: Floor, DB riser.</p> <p>Z_{db}: 0.11 (Ω) I_{pf} at DB: 4.24 (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (✓)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (N/A)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 3L1</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
--	---	--

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**		Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button		
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)		
6L3	0.34	0.36	0.87	0.30	N/A	LIM	11.0	500	✓	0.45	38.6	✓	N/A	N/A	
7L1	0.49	0.49	1.31	0.43	N/A	LIM	>999	500	✓	0.50	38.7	✓	N/A	N/A	
7L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
7L3	0.36	0.36	0.98	0.31	N/A	LIM	201	500	✓	0.42	28.8	✓	N/A	N/A	
8L1	N/A	N/A	N/A	0.10	N/A	LIM	107	500	✓	0.17	29.9	✓	N/A	N/A	
8L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
8L3	N/A	N/A	N/A	0.20	N/A	LIM	841	500	✓	0.27	28.8	✓	N/A	N/A	
9L1	0.18	0.18	0.48	0.17	N/A	LIM	48.3	500	✓	0.30	28.4	✓	N/A	N/A	
9L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
9L3	0.33	0.33	0.88	0.30	N/A	LIM	223	500	✓	0.44	29.1	✓	N/A	N/A	
10L1	N/A	N/A	N/A	0.20	N/A	LIM	>999	500	✓	0.27	N/A	N/A	N/A	N/A	
10L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
10L3	N/A	N/A	N/A	0.44	N/A	LIM	>999	500	✓	0.51	N/A	N/A	N/A	N/A	
11L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
12L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
12L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 20/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

Original (to the person ordering the work)

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Z _s * (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)	
12L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: DB3 Caswell-Second Floor. Lighting and Small Power</p> <p>Location of DB: Floor DB riser - Second</p> <p>Z_{db}: 0.11 (Ω) I_{pr} at DB†: 4.24 (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (✓)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (N/A)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 3L1</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
--	---	--



This certificate is not valid if the serial number has been defaced or altered

29871895

ISN18.2c

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Zs (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)	
12L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature:  Date: 20/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)

Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A
-------------------------------------	--------------------	-------------------------------	------------------------------------	------------------------------------	-------------

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
--------------------------	---	--	--	---	---	--------------------------------	--------------------------------	------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)	
	Main Switch	N/A	N/A	N/A	N/A	N/A	N/A	60947-3	3	125	N/A	N/A	N/A	N/A	N/A	N/A	N/A
1L1	Bedroom Lighting rooms 1-4	A	E	25	1.5	1	0.4	61009	B	10	10	3.5	61009	A	10	30	
1L2	Bedroom Lighting rooms 9-12	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30	
1L3	Corridor lighting K1	A	E	12	1.5	1	0.4	60898	B	10	10	3.5	N/A	N/A	N/A	N/A	
2L1	Bedroom Lighting rooms 5-8	A	E	24	1.5	1	0.4	61009	B	10	10	3.5	61009	A	10	30	
2L2	Bedroom Lighting 13-16	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30	
2L3	Corridor lighting K2	A	E	11	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
3L1	Kitchen Lighting K1	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
3L2	Kitchen Lighting K2	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
3L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L3	Lobby lighting	A	E	10	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
5L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L3	Stairwell Lighting - 3rd, 4th & 5th Floor	A	E	14	1.5	1	0.4	60898	B	10	10	1.75	N/A	N/A	N/A	N/A	
6L1	Bedroom Ring Main rooms 9-11	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30	
6L2	Bedroom Ring Main rooms 5-8	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30	

DISTRIBUTION BOARD (DB) DETAILS (complete in every case)

DB4 Caswell-Third Floor.
 DB designation: Lighting and Small Power
 Caswell building - Third Floor, DB Riser

Location of DB: Floor, DB Riser

Z_{db}: 0.12 (Ω) I_{pr} at DB†: 3.8 (kA)

Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)

SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)

Status indicator checked (where functionality indicator is present): (N/A)

**SPD Type.

Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.

Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).

Note that not all SPDs have visible functionality indication.

TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION

Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 4L1

Overcurrent protective device for the distribution circuit

BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)

Associated RCD (if any)

BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Zs (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time* (ms)	Test button (✓)	AFDD test button (✓)	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)						
	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
1L1	N/A	N/A	N/A	1.61	N/A	LIM	912	500	✓	1.68	28.7	✓	N/A	N/A
1L2	N/A	N/A	N/A	1.22	N/A	LIM	>999	500	✓	1.29	28.7	✓	N/A	N/A
1L3	N/A	N/A	N/A	1.66	N/A	LIM	>999	500	✓	1.73	N/A	N/A	N/A	N/A
2L1	N/A	N/A	N/A	1.52	N/A	LIM	493	500	✓	1.59	28.8	✓	N/A	N/A
2L2	N/A	N/A	N/A	1.10	N/A	LIM	518	500	✓	1.17	28.8	✓	N/A	N/A
2L3	N/A	N/A	N/A	1.34	N/A	LIM	563	500	✓	1.41	N/A	N/A	N/A	N/A
3L1	N/A	N/A	N/A	0.93	N/A	LIM	225	500	✓	1.00	N/A	N/A	N/A	N/A
3L2	N/A	N/A	N/A	0.65	N/A	LIM	951	500	✓	0.72	N/A	N/A	N/A	N/A
3L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L3	N/A	N/A	N/A	1.28	N/A	LIM	241	500	✓	1.35	N/A	N/A	N/A	N/A
5L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L3	N/A	N/A	N/A	1.41	N/A	LIM	579	500	✓	1.48	N/A	N/A	N/A	N/A
6L1	0.35	0.35	0.90	0.31	N/A	LIM	392	500	✓	0.42	38.3	✓	N/A	N/A
6L2	0.45	0.45	1.17	0.41	N/A	LIM	139	500	✓	0.55	38.6	✓	N/A	Zs is greater than 80% and less than 100% of BS7671 values. But protected by an RCD

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 21/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)

Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A
-------------------------------------	--------------------	-------------------------------	------------------------------------	------------------------------------	-------------

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	---	--	--	---	---	--------------------------------	--------------------------------	------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
					6L3	General Ring Main - Cor,Lob,Strs		A	E	6	4	1.5	0.4	61009	C	32
7L1	Bedroom Ring Main rooms 13-16	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L2	Bedroom Ring Main rooms 1-4	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8L1	Cooker Supply K1	A	C	2	10	4	5	61009	C	40	10	0.44	61009	A	40	30
8L2	Cooker Supply K2	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	32	30
8L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
9L1	Kitchen Ring Main K1	A	C	8	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
9L2	Kitchen Ring Main K2	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
9L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L1	Hob Supply K1	A	C	1	4	1.5	0.4	60898	C	20	10	0.87	N/A	N/A	N/A	N/A
10L2	Hob Supply K2	A	C	1	4	1.5	0.4	60898	C	20	10	0.87	N/A	N/A	N/A	N/A
10L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB4 Caswell-Third Floor. DB designation: Lighting and Small Power Caswell building - Third Location of DB: Floor, DB, Riser</p> <p>Z_{db}: 0.12 (Ω) I_{pf} at DB†: 3.8 (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (N/A)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 4L1</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
---	---	--

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Zs (Ω)	RCD		AFDD**		Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button		
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)		
6L3	0.45	0.45	1.2	0.40	N/A	LIM	36.1	500	✓	0.54	28.6	✓	N/A	N/A	
7L1	0.43	0.43	1.13	0.35	N/A	LIM	>999	500	✓	0.45	38.6	✓	N/A	N/A	
7L2	0.55	0.55	1.45	0.46	N/A	LIM	>999	500	✓	0.58	38.5	✓	N/A	N/A	Zs is greater than 80% and less than 100% of BS7671 values. But protected by an RCD
7L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
8L1	N/A	N/A	N/A	0.22	N/A	LIM	>999	500	✓	0.29	28.7	✓	N/A	N/A	
8L2	N/A	N/A	N/A	0.11	N/A	LIM	95.1	500	✓	0.18	28.8	✓	N/A	N/A	
8L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
9L1	0.40	0.40	0.99	0.35	N/A	LIM	16.0	500	✓	0.43	28.5	✓	N/A	N/A	
9L2	0.25	0.25	0.65	0.23	N/A	LIM	>999	500	✓	0.30	28.5	✓	N/A	N/A	
9L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
10L1	N/A	N/A	N/A	0.47	N/A	LIM	>999	500	✓	0.54	N/A	N/A	N/A	N/A	
10L2	N/A	N/A	N/A	0.21	N/A	LIM	>999	500	✓	0.28	N/A	N/A	N/A	N/A	
10L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
12L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
12L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 21/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live	cpc		BS (EN)	Type	Rating	Short-circuit capacity	Maximum permitted Zs*	BS (EN)	Type	Rating	Operating current, I _{Δn}	
					(mm ²)	(mm ²)											(A)
12L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

DISTRIBUTION BOARD (DB) DETAILS (complete in every case)

DB designation: DB4 Caswell-Third Floor.
Lighting and Small Power

Location of DB: Floor DB Riser
Caswell building - Third

Z_{db} : 0.12 (Ω) I_{pf} at DB†: 3.8 (kA)

Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)

SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)

Status indicator checked (where functionality indicator is present): (N/A)

**SPD Type.

Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.

Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).

Note that not all SPDs have visible functionality indication.

TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION

Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 4L1

Overcurrent protective device for the distribution circuit

BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)

Associated RCD (if any)

BS (EN): (N/A) RCD Type: (N/A) $I_{Δn}$: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms

Original (to the person ordering the work)



This certificate is not valid if the serial number has been defaced or altered

29871895

ISN18.2c

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

Original (to the person ordering the work)

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z_s (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r_1	(Neutral) r_n	(cpc) r_2	($R_1 + R_2$)	R_2	(M Ω)	(M Ω)	(V)			(ms)	(✓)	(✓)	
12L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 21/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current ($I_{\Delta n}$) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	---	--	--	---	---	--------------------------------	--------------------------------	------------------------------	--------------------

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)	
	Main Switch	N/A	N/A	N/A	N/A	N/A	N/A	60947-3	3	125	N/A	N/A	N/A	N/A	N/A	N/A	N/A
1L1	Corridor lighting K1	A	E	11	1.5	1	0.4	60898	B	10	10	3.5	N/A	N/A	N/A	N/A	
1L2	Bedroom Lighting rooms 1-4	A	E	25	1.5	1	0.4	61009	B	10	10	3.5	61009	A	10	30	
1L3	Bedroom Lighting rooms 9-12	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30	
2L1	Corridor lighting K2	A	E	11	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
2L2	Bedroom Lighting rooms 5-8	A	E	24	1.5	1	0.4	61009	B	10	10	3.50	61009	A	10	30	
2L3	Bedroom Lighting rooms 13-16	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30	
3L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
3L2	Kitchen Lighting K1	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
3L3	Kitchen Lighting K2	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
4L1	Lobby Lighting	A	E	11	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
4L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
6L1	General Ring Main - Cor,Lob,Strs	A	E	6	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30	
6L2	Bedroom Ring Main rooms 9-12	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30	

DISTRIBUTION BOARD (DB) DETAILS (complete in every case)

DB5 Caswell-Fourth Floor.
 DB designation: Lighting and Small Power
 Caswell building - Fourth
 Location of DB: Floor, DB riser

Z_{db}: 0.18 (Ω) I_{pf} at DB†: 3.38 (kA)

Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)

SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)

Status indicator checked (where functionality indicator is present): (N/A)

**SPD Type.
 Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.
 Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).
 Note that not all SPDs have visible functionality indication.

TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION

Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 5L1

Overcurrent protective device for the distribution circuit
 BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)

Associated RCD (if any)
 BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**		Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button		
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)		
	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
1L1	N/A	N/A	N/A	1.48	N/A	LIM	566	500	✓	1.55	N/A	N/A	N/A	N/A	
1L2	N/A	N/A	N/A	1.57	N/A	LIM	401	500	✓	1.64	28.8	✓	N/A	N/A	
1L3	N/A	N/A	N/A	1.44	N/A	LIM	643	500	✓	1.51	28.7	✓	N/A	N/A	
2L1	N/A	N/A	N/A	1.20	N/A	LIM	>999	500	✓	1.27	N/A	N/A	N/A	N/A	
2L2	N/A	N/A	N/A	1.44	N/A	LIM	526	500	✓	1.51	28.9	✓	N/A	N/A	
2L3	N/A	N/A	N/A	1.16	N/A	LIM	634	500	✓	1.23	28.8	✓	N/A	N/A	
3L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
3L2	N/A	N/A	N/A	0.77	N/A	LIM	478	500	✓	0.84	N/A	N/A	N/A	N/A	
3L3	N/A	N/A	N/A	0.53	N/A	LIM	>999	500	✓	0.60	N/A	N/A	N/A	N/A	
4L1	N/A	N/A	N/A	1.34	N/A	LIM	317	500	✓	1.41	N/A	N/A	N/A	N/A	
4L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
6L1	0.40	0.41	1.05	0.36	N/A	LIM	21.1	500	✓	0.48	28.5	✓	N/A	N/A	
6L2	0.44	0.44	1.17	0.40	N/A	LIM	>999	500	✓	0.53	28.7	✓	N/A	N/A	

Circuits/equipment vulnerable to damage when testing (where applicable): Lamos, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 24/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
					6L3	Bedroom Ring Main rooms 5-8		A	E	12	4	1.5	0.4	61009	C	32
7L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
7L2	Bedroom Ring Main rooms 13-16	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L3	Bedroom Ring Main rooms 1-4	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
8L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8L2	Cooker Supply K1	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	32	30
8L3	Cooker Supply K2	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	32	30
9L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
9L2	Kitchen Ring Main K1	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
9L3	Kitchen Ring Main K2	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
10L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L2	Hob Supply K1	A	C	1	4	1.5	0.4	60898	C	25	10	0.70	N/A	N/A	N/A	N/A
10L3	Hob Supply K2	A	C	1	4	1.5	0.4	60898	C	25	10	0.70	N/A	N/A	N/A	N/A
11L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

DISTRIBUTION BOARD (DB) DETAILS (complete in every case)

DB5 Caswell-Fourth Floor.
 DB designation: Lighting and Small Power
 Caswell building - Fourth
 Location of DB: Floor, DB riser

Z_{db}: 0.18 (Ω) I_{pf} at DB†: 3.38 (kA)

Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)

SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)

Status indicator checked (where functionality indicator is present): (N/A)

**SPD Type.
 Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.
 Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).
 Note that not all SPDs have visible functionality indication.

TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION

Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 5L1

Overcurrent protective device for the distribution circuit
 BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)

Associated RCD (if any)
 BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)	
6L3	0.41	0.42	1.09	0.37	N/A	LIM	>999	500	✓	0.49	38.6	✓	N/A	N/A
7L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
7L2	0.49	0.50	1.30	0.42	N/A	LIM	804	500	✓	0.55	38.7	✓	N/A	N/A
7L3	0.45	0.45	1.20	0.41	N/A	LIM	118	500	✓	0.56	38.6	✓	N/A	N/A
8L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8L2	N/A	N/A	N/A	0.23	N/A	LIM	928	500	✓	0.30	28.8	✓	N/A	N/A
8L3	N/A	N/A	N/A	0.14	N/A	LIM	734	500	✓	0.21	29.1	✓	N/A	N/A
9L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
9L2	0.49	0.47	1.30	0.41	N/A	LIM	233	500	✓	0.53	28.5	✓	N/A	N/A
9L3	0.44	0.44	1.16	0.39	N/A	LIM	158	500	✓	0.48	28.6	✓	N/A	N/A
10L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10L2	N/A	N/A	N/A	0.45	N/A	LIM	>999	500	✓	0.52	N/A	N/A	N/A	N/A
10L3	N/A	N/A	N/A	0.23	N/A	LIM	>999	500	✓	0.30	N/A	N/A	N/A	N/A
11L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamos, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 24/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)



This certificate is not valid if the serial number has been defaced or altered

29871895

ISN18.2c

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Z _s * (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)	
12L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

DISTRIBUTION BOARD (DB) DETAILS (complete in every case)

DB designation: DB5 Caswell-Fourth Floor.
Lighting and Small Power

Location of DB: Floor DB riser.
Caswell building - Fourth

Z_{db}: 0.18 (Ω) I_{pr} at DB†: 3.38 (kA)

Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)

SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)

Status indicator checked (where functionality indicator is present): (N/A)

**SPD Type.
Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.
Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).
Note that not all SPDs have visible functionality indication.

TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION

Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 5L1

Overcurrent protective device for the distribution circuit
BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)

Associated RCD (if any)
BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms

Original (to the person ordering the work)



This certificate is not valid if the serial number has been defaced or altered

29871895 ISN18.2c

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Zs (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)	
12L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamos, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *G. Richards* Date: 24/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)

Multi-function:	Continuity:	Insulation resistance:	Earth fault loop impedance:	Earth electrode resistance:	RCD:
1008121101865459	N/A	N/A	N/A	N/A	N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)	
	Main Switch	N/A	N/A	N/A	N/A	N/A	N/A	60947-3	3	125	N/A	N/A	N/A	N/A	N/A	N/A	N/A
1L1	Bedroom Lighting rooms 9-12	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30	
1L2	Corridor lighting K1	A	E	11	1.5	1	0.4	60898	B	10	10	3.5	N/A	N/A	N/A	N/A	
1L3	Bedroom Lighting rooms 1-4	A	E	25	1.5	1	0.4	61009	B	10	10	3.5	61009	A	10	30	
2L1	Bedroom Lighting rooms 13-16	A	E	24	1.5	1	0.4	61009	C	10	10	1.75	61009	A	10	30	
2L2	Corridor lighting K2	A	E	11	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
2L3	Bedroom Lighting rooms 5-8	A	E	24	1.5	1	0.4	61009	B	10	10	3.5	61009	A	10	30	
3L1	Kitchen Lighting K2	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
3L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
3L3	Kitchen Lighting K1	A	C	3	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
4L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
4L2	Lobby Lighting	A	E	10	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
4L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
5L2	Plantroom Lighting - top floor	A	E	5	1.5	1	0.4	60898	C	10	10	1.75	N/A	N/A	N/A	N/A	
5L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
6L1	Bedroom Ring Main rooms 5-8	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30	
6L2	General Ring Main - Cor,Lob,Strs	A	E	6	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30	

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB6 Caswell- Fifth Floor. DB designation: Lighting and Small Power Caswell building - Fifth Location of DB: Floor, DB riser</p> <p>Z_{db}: 0.15 (Ω) I_{pr} at DB: 3.02 (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (N/A)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 6L1</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
--	---	--

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**		Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button		
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)		
	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
1L1	N/A	N/A	N/A	1.21	N/A	LIM	>999	500	✓	1.28	28.7	✓	N/A	N/A	N/A
1L2	N/A	N/A	N/A	1.72	N/A	LIM	>999	500	✓	1.79	N/A	N/A	N/A	N/A	N/A
1L3	N/A	N/A	N/A	1.65	N/A	LIM	>999	500	✓	1.72	28.7	✓	N/A	N/A	N/A
2L1	N/A	N/A	N/A	1.27	N/A	LIM	>999	500	✓	1.34	28.7	✓	N/A	N/A	N/A
2L2	N/A	N/A	N/A	1.43	N/A	LIM	>999	500	✓	1.50	N/A	N/A	N/A	N/A	N/A
2L3	N/A	N/A	N/A	1.62	N/A	LIM	485	500	✓	1.69	28.6	✓	N/A	N/A	N/A
3L1	N/A	N/A	N/A	0.60	N/A	LIM	684	500	✓	0.67	N/A	N/A	N/A	N/A	N/A
3L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
3L3	N/A	N/A	N/A	0.91	N/A	LIM	554	500	✓	0.98	N/A	N/A	N/A	N/A	N/A
4L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4L2	N/A	N/A	N/A	1.78	N/A	LIM	>999	500	✓	1.85	N/A	N/A	N/A	N/A	N/A
4L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5L2	N/A	N/A	N/A	0.62	N/A	LIM	>999	500	✓	0.69	N/A	N/A	N/A	N/A	N/A
5L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6L1	0.46	0.46	1.19	0.41	N/A	LIM	>999	500	✓	0.51	38.7	✓	N/A	N/A	N/A
6L2	0.48	0.49	1.22	0.41	N/A	LIM	202	500	✓	0.52	38.6	✓	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 25/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD			
					Live (mm ²)	cpc (mm ²)		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)
					6L3	Bedroom Ring Main rooms 9-12		A	E	12	4	1.5	0.4	61009	C	32
7L1	Bedroom Ring Main rooms 1-4	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
7L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
7L3	Bedroom Ring Main rooms 13-16	A	E	12	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
8L1	Cooker Supply K1	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	10	30
8L2	Plantroom Sockets - top floor	A	E	3	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
8L3	Cooker Supply K2	A	C	2	10	4	0.4	61009	C	32	10	0.54	61009	A	10	30
9L1	Kitchen Ring Main K2	A	C	7	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
9L2	Plantroom Metering Interface IBMS	A	E	1	4	1.5	0.4	60898	C	20	10	0.87	N/A	N/A	N/A	N/A
9L3	Kitchen Ring Main K1	A	C	9	4	1.5	0.4	61009	C	32	10	0.54	61009	A	32	30
10L1	Hob Supply K2	A	C	1	4	1.5	0.4	60898	C	25	10	0.70	N/A	N/A	N/A	N/A
10L2	NTL Hub Plantroom	A	E	1	4	1.5	0.4	60898	C	20	10	0.87	N/A	N/A	N/A	N/A
10L3	Hob Supply K1	A	C	1	4	1.5	0.4	60898	C	25	10	0.87	N/A	N/A	N/A	N/A
11L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

DISTRIBUTION BOARD (DB) DETAILS (complete in every case)

DB designation: DB6 Caswell- Fifth Floor.
 Location of DB: Floor, DB riser.
 Z_{db}: 0.15 (Ω) I_{pf} at DB†: 3.02 (kA)
 Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)
 SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)
 Status indicator checked (where functionality indicator is present): (N/A)

**SPD Type.
 Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.
 Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).
 Note that not all SPDs have visible functionality indication.

TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION

Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 6L1
 Overcurrent protective device for the distribution circuit
 BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)
 Associated RCD (if any)
 BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**		Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button		
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)		
6L3	0.33	0.33	0.83	0.29	N/A	LIM	>999	500	✓	0.41	38.7	✓	N/A	N/A	
7L1	0.49	0.49	1.27	0.44	N/A	LIM	>999	500	✓	0.54	38.9	✓	N/A	N/A	
7L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
7L3	0.33	0.33	0.90	0.31	N/A	LIM	>999	500	✓	0.46	38.7	✓	N/A	N/A	
8L1	N/A	N/A	N/A	0.31	N/A	LIM	>999	500	✓	0.44	28.8	✓	N/A	N/A	
8L2	0.26	0.27	0.69	0.24	N/A	LIM	233	500	✓	0.39	38.9	✓	N/A	N/A	
8L3	N/A	N/A	N/A	0.12	N/A	LIM	>999	500	✓	0.19	28.8	✓	N/A	N/A	
9L1	0.21	0.21	0.57	0.20	N/A	LIM	154	500	✓	0.33	28.4	✓	N/A	N/A	
9L2	N/A	N/A	N/A	0.43	N/A	LIM	>999	500	✓	0.50	N/A	N/A	N/A	N/A	
9L3	0.31	0.31	0.81	0.28	N/A	LIM	366	500	✓	0.41	39.2	✓	N/A	N/A	
10L1	N/A	N/A	N/A	0.23	N/A	LIM	>999	500	✓	0.30	N/A	N/A	N/A	N/A	
10L2	N/A	N/A	N/A	0.38	N/A	LIM	559	500	✓	0.45	N/A	N/A	N/A	N/A	
10L3	N/A	N/A	N/A	0.47	N/A	LIM	>999	500	✓	0.54	N/A	N/A	N/A	N/A	
11L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
11L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
12L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
12L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: *[Signature]* Date: 25/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 1008121101865459	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

* RCD effectiveness is verified using an alternating current test at rated residual operating current (I_{Δn}) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): N/A
---------------------------------	--	---	---	--	--	---------------------------------------	---------------------------------------	-------------------------------------	--------------------

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART A : SCHEDULE OF CIRCUIT DETAILS (GO TO Part B 'Schedule of Test Results' to enter test results for the corresponding circuit listed in this part)

Circuit number	Circuit description	Type of wiring (see footer to PART B)	Reference Method (BS 7671)	Number of points served	Circuit conductor (number & csa)		Max. disconnection time (BS 7671) (s)	Overcurrent protective device					RCD				
					Live	cpc		BS (EN)	Type	Rating (A)	Short-circuit capacity (kA)	Maximum permitted Zs* (Ω)	BS (EN)	Type	Rating (A)	Operating current, I _{Δn} (mA)	
					(mm ²)	(mm ²)											(mm ²)
12L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

<p>DISTRIBUTION BOARD (DB) DETAILS (complete in every case)</p> <p>DB designation: DB6 Caswell - Fifth Floor. Lighting and Small Power.....</p> <p>Location of DB: Floor, DB riser..... Caswell building - Fifth</p> <p>Z_{db}: 0.15..... (Ω) I_{pf} at DB†: 3.02..... (kA)</p> <p>Confirmation of supply polarity: (✓) Phase sequence confirmed†: (N/A)</p> <p>SPD Details** Types: T1 (N/A) T2 (N/A) T3 (N/A) N/A (✓)</p> <p>Status indicator checked (where functionality indicator is present): (N/A)</p>	<p>**SPD Type.</p> <p>Where combined T1 + T2 or T2 + T3 device is installed, indicate by ticking both Type brackets.</p> <p>Where T3 devices are installed on a circuit to protect sensitive equipment, enter details in 'Comments' (PART B), (See Section 534 for further details).</p> <p>Note that not all SPDs have visible functionality indication.</p>	<p>TO BE COMPLETED ONLY IF THE DB IS NOT CONNECTED DIRECTLY TO THE ORIGIN OF THE INSTALLATION</p> <p>Supply to DB is from: MDB Caswell. 12way TP+N. Main LV Switch Board - 6L1</p> <p>Overcurrent protective device for the distribution circuit</p> <p>BS (EN): (60947-2) Type: (MCCB) Nominal voltage: (400) V Rating: (80) A No. of phases: (3)</p> <p>Associated RCD (if any)</p> <p>BS (EN): (N/A) RCD Type: (N/A) I_{Δn}: (N/A) mA No. of poles: (N/A) Operating time: (N/A) ms</p>
---	--	--

Original (to the person ordering the work)

CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z _s (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time* (ms)	Test button (✓)	AFDD test button (✓)	
	(Line) r ₁	(Neutral) r _n	(cpc) r ₂	(R ₁ + R ₂)	R ₂	(MΩ)	(MΩ)	(V)						
12L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): Lamps, Neons, RCDs, Electronic Equipment.

TESTED BY Name (capitals): GRAYSON RICHARDS Position: Electrician Signature: Date: 25/06/2024

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)

Multi-function: <u>1008121101865459</u>	Continuity: <u>N/A</u>	Insulation resistance: <u>N/A</u>	Earth fault loop impedance: <u>N/A</u>	Earth electrode resistance: <u>N/A</u>	RCD: <u>N/A</u>
--	---------------------------	--------------------------------------	---	---	--------------------

* RCD effectiveness is verified using an alternating current test at rated residual operating current ($I_{\Delta n}$) ** Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): <u>N/A</u>
--------------------------	---	--	--	---	---	--------------------------------	--------------------------------	------------------------------	---------------------------



This certificate is not valid if the serial number has been defaced or altered

29871895

N18.2c

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

9.2 Other special installations or locations

N/A

N/A

Original (to the person ordering the work)



This certificate is not valid if the serial number has been defaced or altered

29871895

N18.2c

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

10. Prosumer's low voltage installation

N/A

NA

Original (to the person ordering the work)



This certificate is not valid if the serial number has been defaced or altered

29871895

IFN18.2c

CONTINUATION SHEET: EICR

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

PART 5 : OBSERVATIONS

One of the following Codes, as appropriate, has been allocated to each of the observations made below to indicate to the person(s) responsible for the electrical installation the degree of urgency for remedial action:	Code C1 Danger Present Risk of injury. Immediate remedial action required	Code C2 Potentially Dangerous Urgent remedial action required	Code C3 Improvement Recommended	Code FI Further Investigation Required
---	---	---	---	--

Referring to the **Schedule of Items Inspected** (see PART 9), the attached **Schedule of Circuit Details and Test Results** (see PART 11A & 11B), and subject to any **agreed limitations** listed in PART 6 –

No remedial action is required (.....), OR The following observations are made:

Item No	Observation(s)	Code	Location Reference
(21)	No SPD in Consumer Unit	(C3)	(DB2)
(22)	No SPD in Consumer Unit	(C3)	(DB3)
(23)	No SPD in Consumer Unit	(C3)	(DB4)
(24)	No SPD in Consumer Unit	(C3)	(DB5)
(25)	No SPD in Consumer Unit	(C3)	(DB6)
(26)	No SPD in Consumer Unit	(C3)	(MDB)
(27)	Max Zs values of circuit 6L2 exceedS the 80% values stated in BS7671 but do not exceed the 100% values with 30mA RCD protection.	(C3)	(DB3)
(28)	Max Zs values of circuits 6L2 + 7L2 exceed the 80% values stated in BS7671 but do not exceed the 100% values with 30mA RCD protection.	(C3)	(DB4)
(29)	Max Zs values of circuit 7L1 exceeds the 80% values stated in BS7671 but do not exceed the 100% values with 30mA RCD protection.	(C3)	(DB5)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)
(.....)	(.....)	(.....)	(.....)

Immediate action required for items: (N/A)	Improvement recommended for items: (21,22,23,24,25,26,27,28,29)
Urgent remedial action required for items: (N/A)	Further investigation required for items: (N/A)

Additional pages? (.....) State page numbers: (.....)

Original (to the person ordering the work)



This certificate is not valid if the serial number has been defaced or altered

29871895

N18.2c

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

General Condition Of the Installation

Main incoming supply to MDB1 mccb board is from the Union House building 11kv sub main room with no access. General condition of the installation is safe for continued use

Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Room 3.07 light replaced



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Room 1.04 water damage



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Room 1.04 water damage



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Floor 3



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

1



© Samsung Camera
Shot with my Galaxy Tab S6 Lite

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

2



© Samsung Camera
Shot with my Galaxy Tab S6 Lite

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

3



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

10



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



Samsung Camera
Shot with my Galaxy Tab S6 Lite

Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

Misc



Samsung Camera
 Shot with my Galaxy Tab S6 Lite


Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc

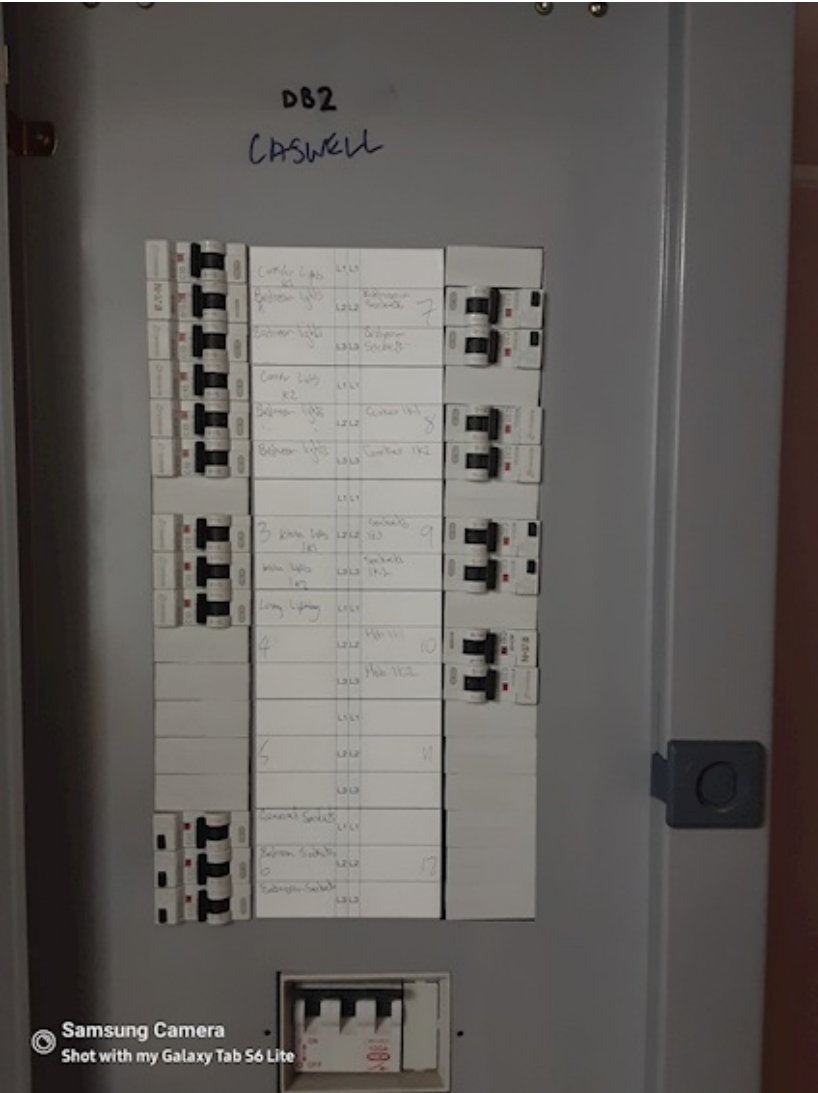

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



© Samsung Camera
Shot with my Galaxy Tab S6 Lite

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

Misc



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

Misc



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

31



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

33



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

34



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

36



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

51




Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

55

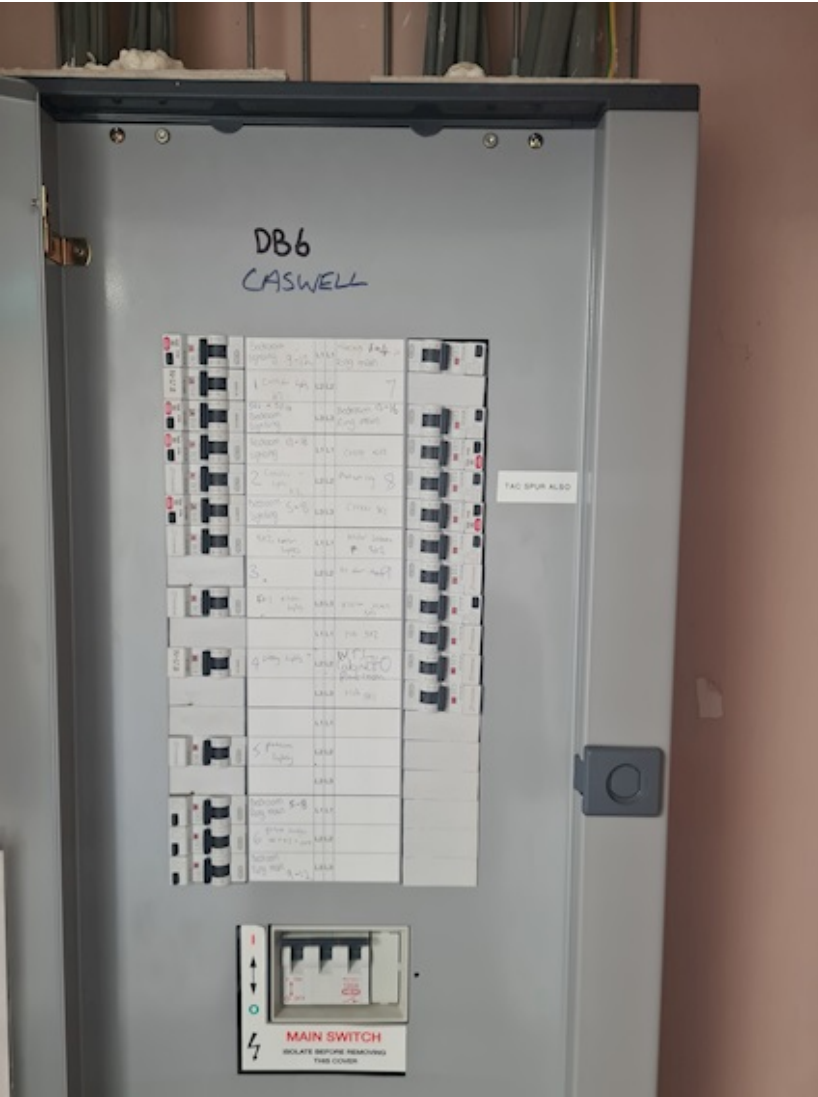

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

54




Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

53

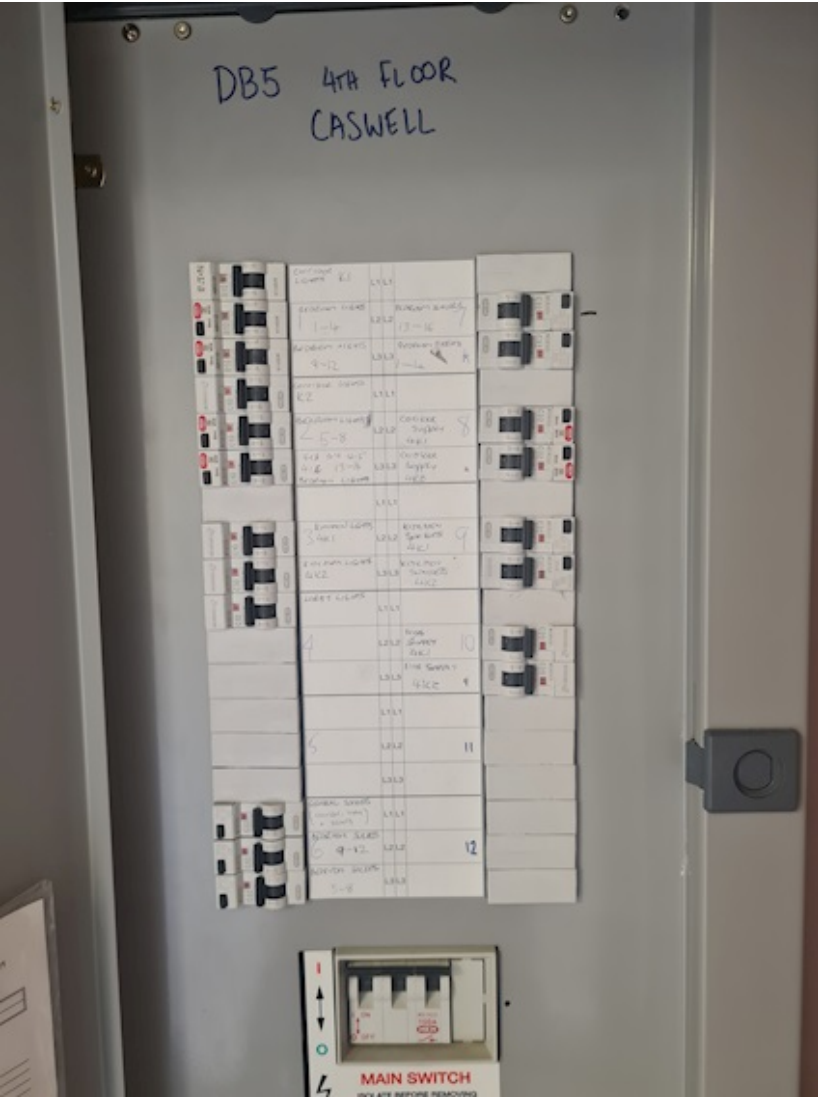

Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

52




GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

51

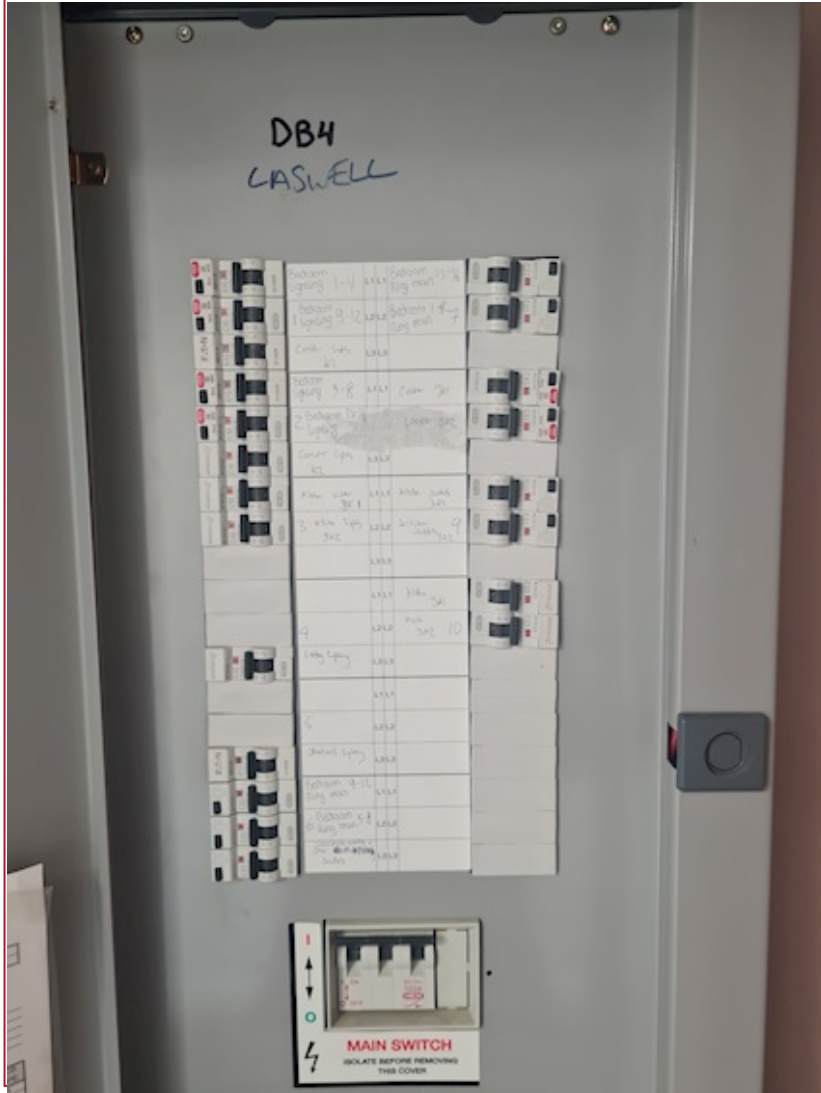


Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

46

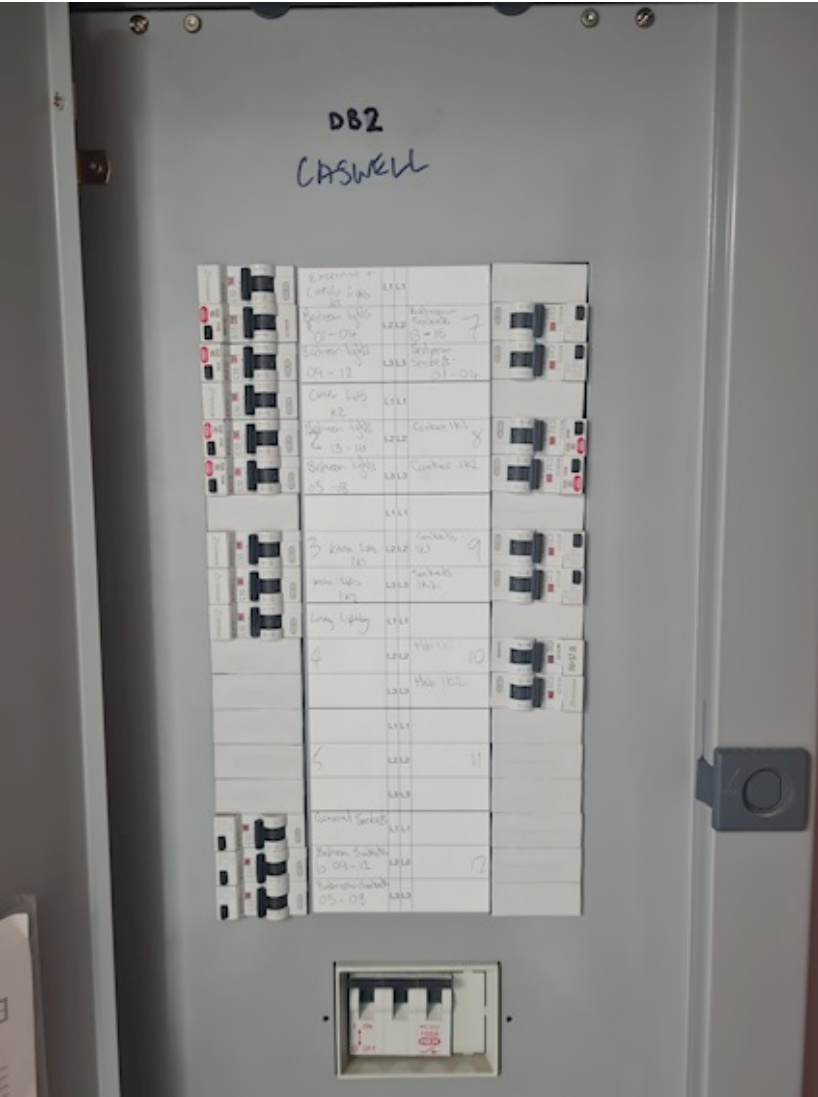

Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

47



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

48



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

49



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

50



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

45



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

44



GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

43



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 – Requirements for Electrical Installations

NOTES

42



Original (to the person ordering the work)

GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018+A2:2022 - Requirements for Electrical Installations

NOTES

56



NOTES FOR RECIPIENT

THIS CONDITION REPORT IS AN IMPORTANT AND VALUABLE DOCUMENT WHICH SHOULD BE RETAINED FOR FUTURE USE

The purpose of periodic inspection is to determine, so far as is reasonably practicable, whether an electrical installation is in a satisfactory condition for continued service. This report provides an assessment of the condition of the electrical installation identified overleaf at the time it was inspected and tested, taking into account the stated extent of the installation and the limitations of the inspection and testing.

This report has been issued in accordance with the national standard for the safety of electrical installations, *BS 7671: 2018+A2:2022* – Requirements for Electrical Installations.

The report identifies any damage, deterioration, defects and/or conditions found by the inspector which may give rise to danger (see PART 5), together with any items for which improvement is recommended.

You should have received the report marked 'Original' and the contractor should retain a duplicate. If you were the person ordering this report, but not the owner or user of the installation, you should pass this report, or a full copy of it, including these notes, the schedules and additional pages (if any), immediately to the owner or user of the installation.

This report should be retained in a safe place and shown to any person inspecting or undertaking further work on the electrical installation in the future. If you later vacate the property, this report will provide the new user with an assessment of the condition of the electrical installation at the time the periodic inspection was carried out.

For safety reasons, the electrical installation should be re-inspected at appropriate intervals by a skilled person or persons, competent in such work. NICEIC* recommends that you engage the services of an NICEIC contractor for the inspection. Only an NICEIC contractor is authorised to issue this NICEIC Electrical Installation Condition Report, which has a unique serial number that is traceable to the contractor to which it was supplied by NICEIC.

The recommended date by which the next inspection should be carried out is stated in PART 4 of this report. With the exception of domestic (household) premises, there should also be a notice at or near the main switchboard or distribution board/consumer unit indicating when the next inspection of the installation is due.

This report is intended to be issued only for the purpose of reporting on the condition of an existing electrical installation and must not be issued to certify new electrical installation work including the replacement of a distribution board or consumer unit.

The report consists of at least eight numbered pages. The report is only valid if the Schedule of Items Inspected (PART 9) has been completed to confirm that all relevant inspections have been carried out and the Schedule of Circuit Details (PART 11A) and the Schedule of Test Results (PART 11B) are attached. For installations having more than one distribution board (or consumer unit) or more circuits than can be recorded in PARTS 11A & 11B, one or more additional Schedule of Circuit Details and Schedule of Test Results, should form part of the report. Additional numbered pages may have been provided to permit further relevant information relating to the installation to be recorded. The report is invalid if any of the additional pages, listed in PART 10 are missing.

Where the installation includes a residual current device (RCD) it should be tested every six months by pressing the button marked "T" or "Test". The device should switch off the supply and should then be switched on to restore the supply. If the device does not switch off the supply when the button is pressed, seek expert advice. For safety reasons it is important that this instruction is followed.

Where the installation includes an arc fault detection device (AFDD) having a manual test facility it should be tested six-monthly by pressing the test button. Where an AFDD has both a test button and automatic test function, manufacturer's instructions should be followed with respect to test button operation.

Where the installation includes a surge protection device (SPD) the status indicator should be checked to confirm it is in operational condition in accordance with manufacturer's information. If the indication shows that the device is not operational, seek expert advice.

Where the installation can be supplied by more than one source, such as the public supply and a standby generator or microgenerator, this should be identified in PART 7 Supply Characteristics and Earthing Arrangements, and the Schedules of Circuit Details and Test Results (PART 11A & 11B) compiled accordingly.

PART 6 (Details and limitations) should identify fully the extent of the installation covered by this report and any limitations on the inspection and testing. The inspector should have agreed these aspects with the person ordering the report and with other interested parties (licensing authority, insurance company, mortgage provider and the like) before the inspection was carried out.

Operational limitations may have been encountered during the inspection such as inability to gain access to parts of the installation or to an item of equipment. The inspector should have noted any such limitations in PART 6. It should be noted that the greater the limitations applying to a report, the less its value from the safety aspect.

A declaration should have been given by the inspector in PART 4 of the report. The declaration must reflect the statement given in PART 3, which summarises the observations and recommendations made in PART 5. Where one or more observations have been made in PART 5, the Classification code given to each by the inspector indicates the degree of urgency with which remedial action needs to be taken to restore the installation to a safe working condition.

Where the inspector has indicated an observation as code C1 (danger present) the safety of those using the installation is at risk. Wherever practicable, items classified as C1 should be made safe on discovery, and it is recommended that a skilled person(s) competent in electrical installation work undertakes the necessary remedial work immediately.

Where the inspector has indicated an observation as code C2 (potentially dangerous) the safety of those using the installation may be at risk, and it is recommended that a skilled person competent in electrical installation work undertakes the necessary remedial work as a matter of urgency.

Where the inspector has indicated that an item requires further investigation (FI), the investigation should be carried out without delay to determine whether danger or potential danger exists. For further guidance on the Classification codes, please see the reverse of page 2.

Where inadequacies in the intake equipment have been observed (Item 1 of PART 9), the person ordering the inspection should inform the distributor and/or supplier as appropriate.

Should the person ordering this report have reason to believe that it does not reasonably reflect the condition of the electrical installation reported on, that person should in the first instance raise the specific concerns in writing with the contractor. If the concerns remain unresolved, the person ordering this report may make a formal complaint to NICEIC, for which purpose a complaint form is available on request.

The complaints procedure offered by NICEIC is subject to certain terms and conditions, full details of which are available upon application. NICEIC does not investigate complaints relating to the operational performance of electrical installations (such as lighting levels), or to contractual or commercial issues (such as time or cost).

For further information about electrical safety and how NICEIC can help you, visit:

www.niceic.com

** NICEIC is operated by Certsure LLP, a partnership between the Electrical Contractors' Association and the charity, Electrical Safety First. NICEIC maintains and publishes registers of electrical contractors that it has assessed against particular scheme requirements (including the technical standard of electrical work).*

GUIDANCE FOR RECIPIENTS ON THE CLASSIFICATION CODES

ONLY ONE CLASSIFICATION CODE SHOULD BE GIVEN FOR EACH RECORDED OBSERVATION

Classification code C1 (Danger present)

Where an observation has been given a Classification code C1, the safety of those using the installation is at risk and immediate remedial action is required.

The person responsible for the maintenance of the installation is advised to take action without delay to remedy the observed deficiency in the installation, or to take other appropriate action (such as switching off and isolating the affected part(s) of the installation) to remove the danger. The NICEIC contractor issuing this report will be able to provide further advice.

NICEIC makes available 'Electrical Danger Notification' forms to enable inspectors to record, and then to communicate to the person ordering the report, any dangerous condition discovered.

Classification code C2 (Potentially dangerous)

Classification code C2 indicates that, whilst those using the installation may not be at immediate risk, urgent remedial action is required to remove potential danger. The NICEIC contractor issuing this report will be able to provide further advice.

It is important to note that the recommendation given for the next inspection date in PART 4 of this report is conditional upon all items which have been given a Classification code C1 and code C2 being remedied immediately and as a matter of urgency, respectively.

It would not be reasonable for the inspector to indicate that the installation is in a satisfactory condition if any observation in this report has been given a code C1 or code C2 classification.

Classification code C3 (Improvement recommended)

Where an observation has been given a Classification code C3, the inspection and/or testing has revealed a non-compliance with the current safety standard which, whilst not presenting immediate or potential danger, would result in a significant safety improvement if remedied. Careful consideration should be given to the safety benefits of improving these aspects of the installation. The NICEIC contractor issuing this report will be able to provide further advice.

Code FI (Further investigation required without delay)

It should usually be possible for the inspector to attribute a Classification code to each observation without indicating a need for further investigation.

However, where 'FI' has been entered against an observation the inspector considers that further investigation of that observation is likely to reveal danger or potential danger that, due to the agreed extent or limitations of the inspection and/or testing (entered in PART 6), could not be fully identified at the time.

It would not be appropriate for the inspector to indicate that the installation is in a satisfactory condition if there is reasonable doubt as to whether danger or potential danger exists. Consequently, where the inspector has indicated 'Further investigation required without delay' (FI) the overall assessment of the installation (PART 3) should be marked as 'Unsatisfactory'.

If the inspector has indicated that an observation requires further investigation without delay, the person ordering this report is advised to arrange for the NICEIC contractor issuing the report (or another skilled person or persons competent in such work) to undertake further examination of that aspect of the installation as a matter of urgency, to determine whether or not danger or potential danger exists.

Further information

Further information on the application of Classification codes, primarily aimed at inspectors but of possible interest to persons ordering condition reports, can be found in Electrical Safety First's Best Practice Guide No 4 *Electrical installation condition reporting: Classification Codes for domestic and similar electrical installations*. The guide can be viewed or downloaded free of charge from www.electricalsafetyfirst.org.uk

For further information about electrical safety and how NICEIC can help you, visit
www.niceic.com